

# SikaSeal®-629 Fire Wrap

## DECLARATION OF PERFORMANCE

### No. 20971646

<b>1</b>	<b>UNIQUE IDENTIFICATION CODE OF THE PRODUCT-TYPE:</b>	20971646
<b>2</b>	<b>INTENDED USE/S</b>	ETA 18/1046/ EAD 350454-00-1104:2017 Fire stopping and fire sealing products, penetration seals
<b>3</b>	<b>MANUFACTURER:</b>	Sika Services AG Tüffenwies 16-22 8064 Zürich
<b>4</b>	<b>AUTHORISED REPRESENTATIVE:</b>	
<b>5</b>	<b>SYSTEM/S OF AVCP:</b>	System 1
<b>6b</b>	<b>EUROPEAN ASSESSMENT DOCUMENT:</b>	EAD 350454-00-1104, Edition 2017 Fire Stopping and Fire Sealing Products, Penetration Seals
	European Technical Assessment:	ETA 18/1046 of 23/01/2019
	Technical Assessment Body:	Warrington Fire Testing and Certification Limited
	Notified body/ies:	1121, 2812

#### Declaration of Performance

SikaSeal®-629 Fire Wrap

20971646

2020.06 , ver. 01

1545

## 7 DECLARED PERFORMANCE/S

The assessment of fitness for use has been made in accordance with EAD 350454-00-1104

Product Type: Wrap		Intended use: Pipe closure device
Basic requirement for construction work	Basic Requirement	Performance
<b>BWR 1 Mechanical resistance and stability</b>		
	None	Not relevant
<b>BWR 2 Safety in case of fire</b>		
EN 13501-1	Reaction to fire	Class E
EN 13501-2	Resistance to fire	Annex A
<b>BWR 3 Hygiene, Health and the Environment</b>		
EN 1026:2000	Air permeability	No performance determined
EAD 350454-00-1104	Water permeability	No performance determined
Declaration by manufacturer	Release of dangerous substances	Use category IA1, S/W3 Declaration of manufacturer
<b>BWR 4 Safety in use</b>		
EOTA TR 001:2003	Mechanical resistance and stability	No performance determined
EOTA TR 001:2003	Resistance to impact/movement	No performance determined
EOTA TR 001:2003	Adhesion	No performance determined
<b>BWR 5 Protection against noise</b>		
EN 10140-2/ EN ISO 717-1	Airborne sound insulation	No performance determined
<b>BWR 6 Energy, Economy and Heat Retention</b>		
EN 12664, EN 12667 or EN 12939	Thermal properties	No performance determined
EN ISO 12572 EN12086	Water vapour permeability	No performance determined
<b>General aspects relating to fitness for use</b>		
EOTA TR 024:2009	Durability and serviceability	X
<b>BWR 7 Sustainable use of natural resources</b>		
		No performance determined

### Declaration of Performance

SikaSeal®-629 Fire Wrap  
20971646  
2020.06 , ver. 01  
1545

## Annex A

### Resistance to Fire Classification of SikaSeal® - 629 Fire Wrap

#### A.1 Intumescent Thickness


The permitted thickness of the intumescent material for various ranges of pipe diameters:

Intumescent Thickness	
Pipe Diameter	Intumescent Material
ø 32 mm - ø 50 mm	1 off 40 mm (W) x 2 (T)
ø 50 mm - ø 82 mm	2 off 40 mm (W) x 2 (T)
ø 82 mm - ø 115 mm	3 off 40 mm (W) x 2 (T)
ø 115 mm - ø 160 mm	4 off 40 mm (W) x 2 (T)
ø 160 mm - ø 200 mm	5 off 40 mm (W) x 2 (T)
ø 200 mm - ø 250 mm	6 off 40 mm (W) x 2 (T)

#### A.2 Floor construction with thickness of minimum 150 mm

##### A.2.1 Penetration seal with SikaSeal® - 629 Fire Wrap installed within both sides of rigid floor

Construction details: Combustible pipes installed with a single SikaSeal® - 629 Fire Wrap within both sides. Maximum annular space according to the tables listed in A.2.1.1 to A.2.1.3 filled with Sikacryl® - 621 Fire.

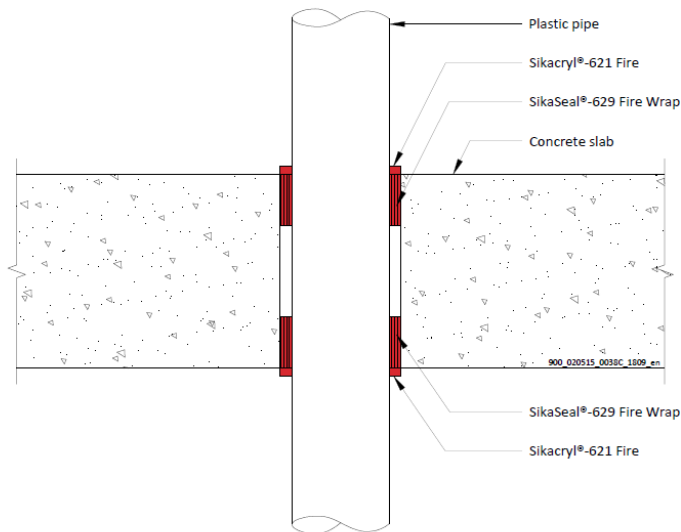


#### Declaration of Performance

SikaSeal®-629 Fire Wrap  
 20971646  
 2020.06 , ver. 01  
 1545

**A.2.1.1 PVC-U pipes with SikaSeal® - 629 Fire Wrap installed within both sides of rigid floor**



PVC pipes according to EN 1452 with SikaSeal® - 629 Fire Wrap.

SikaSeal® - 629 Fire Wrap, Friction Fitted Flush to Both Sides of Rigid Floor (min 150 mm thick) PVC Pipes			
Penetration Specification	Wrap Size / Number	Annulus Space (mm)	Classification
PVC Pipe 32 mm $\phi$ 1.8 mm wall thickness	1 off 40 mm (W) x 2 mm (T)	4	EI 120 U/C
PVC Pipe 40 mm $\phi$ 1.8 mm wall thickness			
PVC Pipe 50 mm $\phi$ 1.8 mm wall thickness			
PVC Pipe 200 mm $\phi$ 7.7 mm wall thickness	5 off 40 mm (W) x 2 mm (T)	12	E 120 U/C
PVC Pipe 200 mm $\phi$ 9.6 mm wall thickness			EI 90 U/C
			EI 60 U/C

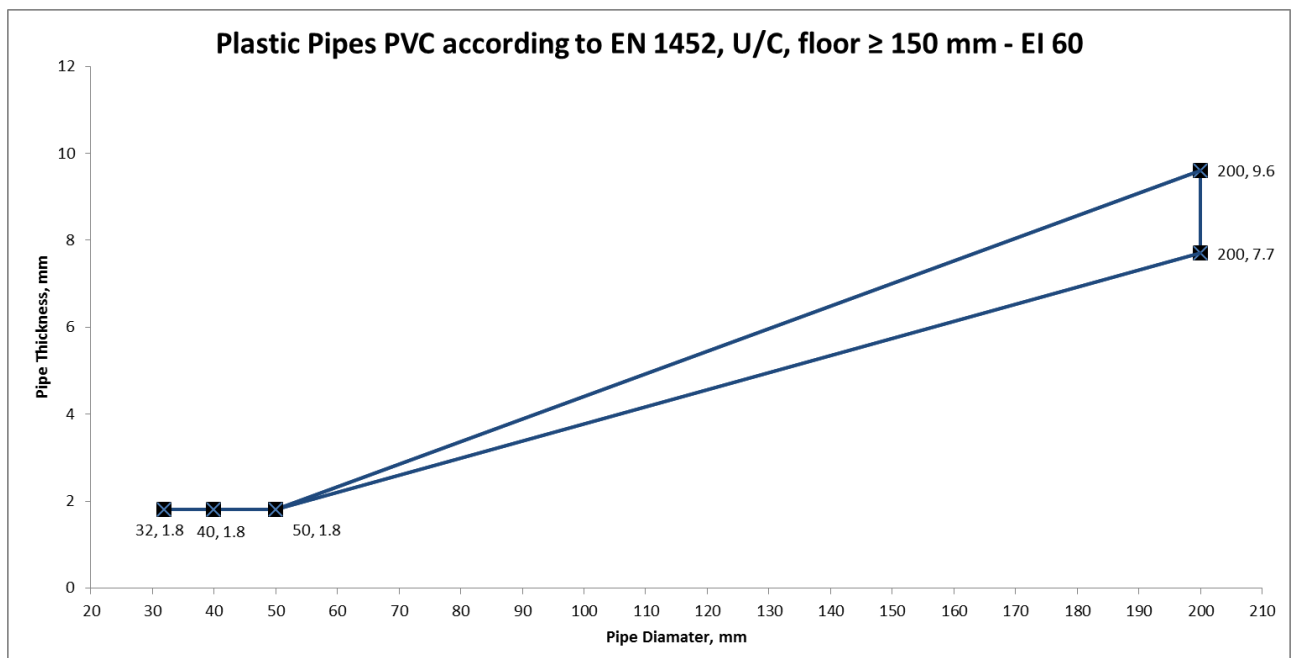

**Declaration of Performance**

SikaSeal®-629 Fire Wrap  
 20971646  
 2020.06 , ver. 01  
 1545

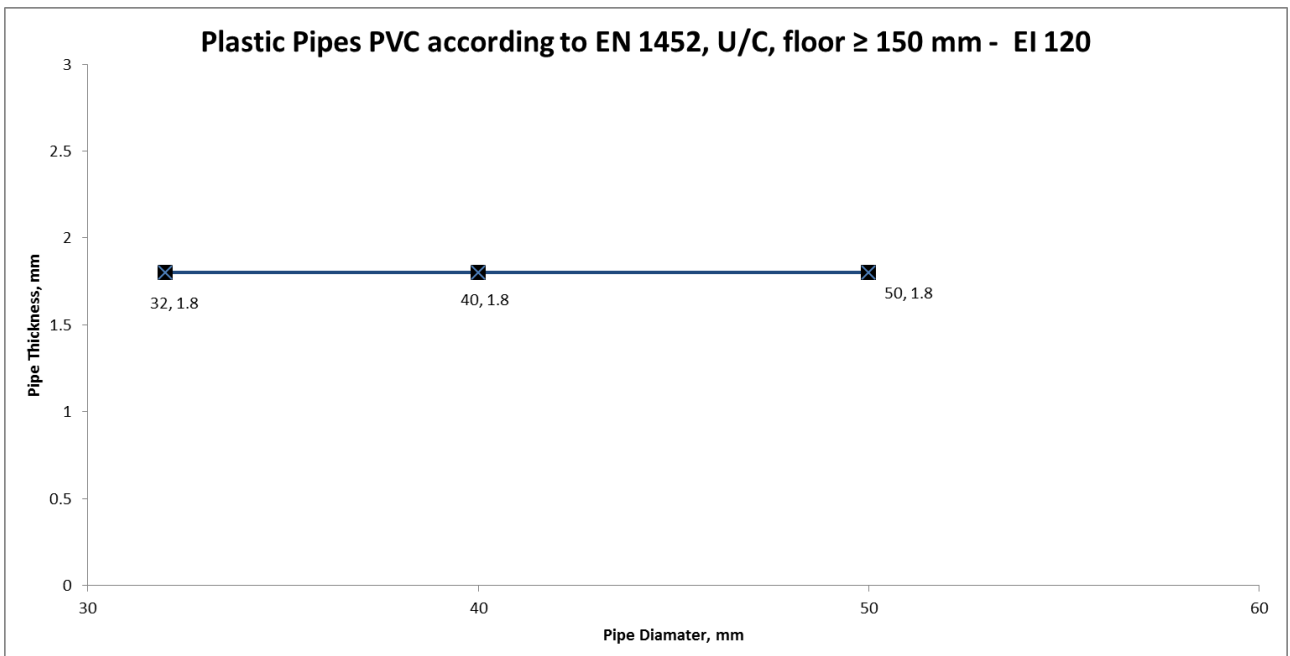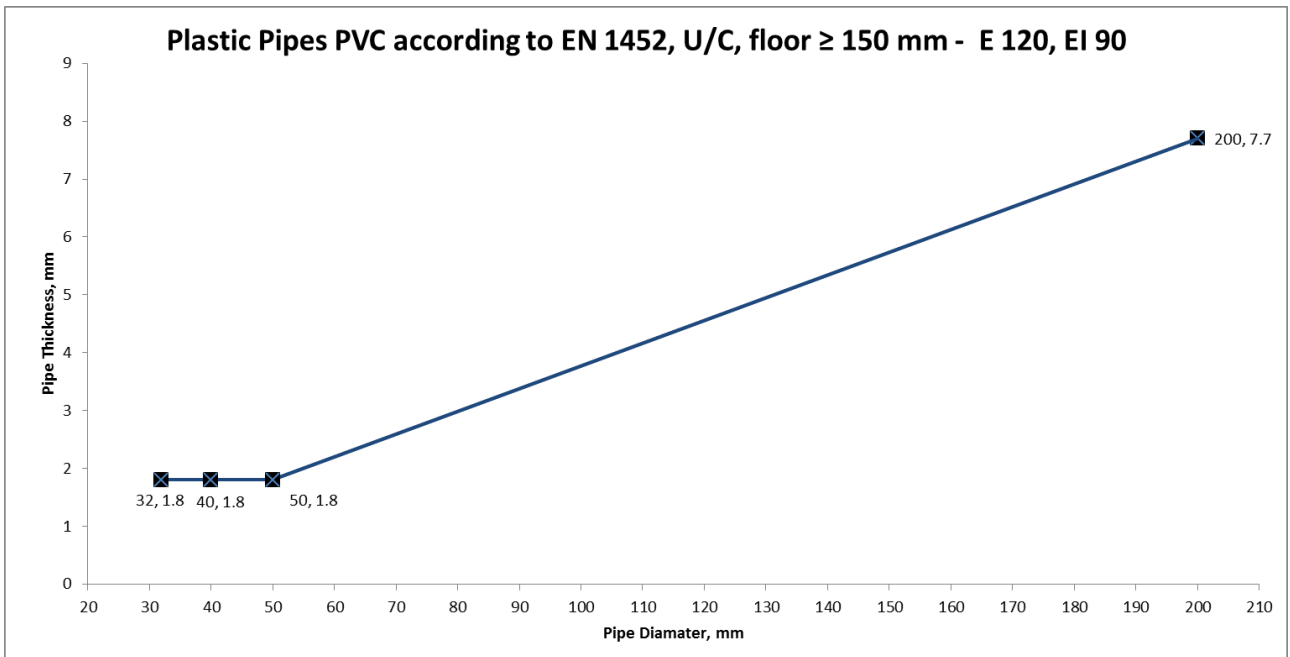

**Declaration of Performance**


SikaSeal®-629 Fire Wrap  
 20971646  
 2020.06 , ver. 01  
 1545



**A.2.1.2 PP pipes with SikaSeal® - 629 Fire Wrap installed within both sides of rigid floor**



PP pipes according to EN 1451 with SikaSeal® - 629 Fire Wrap.

SikaSeal® - 629 Fire Wrap, Friction Fitted Flush to Both Sides of Rigid Floor (min 150 mm thick) PP Pipes			
Penetration Specification	Wrap Size / Number	Annulus Space (mm)	Classification
PP Pipe 32 mm $\phi$ 2.9 mm wall thickness	1 off 40 mm (W) x 2 mm (T)	4	EI 120 U/C
PP Pipe 40 mm $\phi$ 2.9 mm wall thickness			
PP Pipe 50 mm $\phi$ 2.9 mm wall thickness			
PP Pipe 200 mm $\phi$ 4.9 mm wall thickness	5 off 40 mm (W) x 2 mm (T)	12	E 20 U/C
PP Pipe 200 mm $\phi$ 18.2 mm wall thickness			EI 15 U/C
			E 120 U/C
			EI 90 U/C

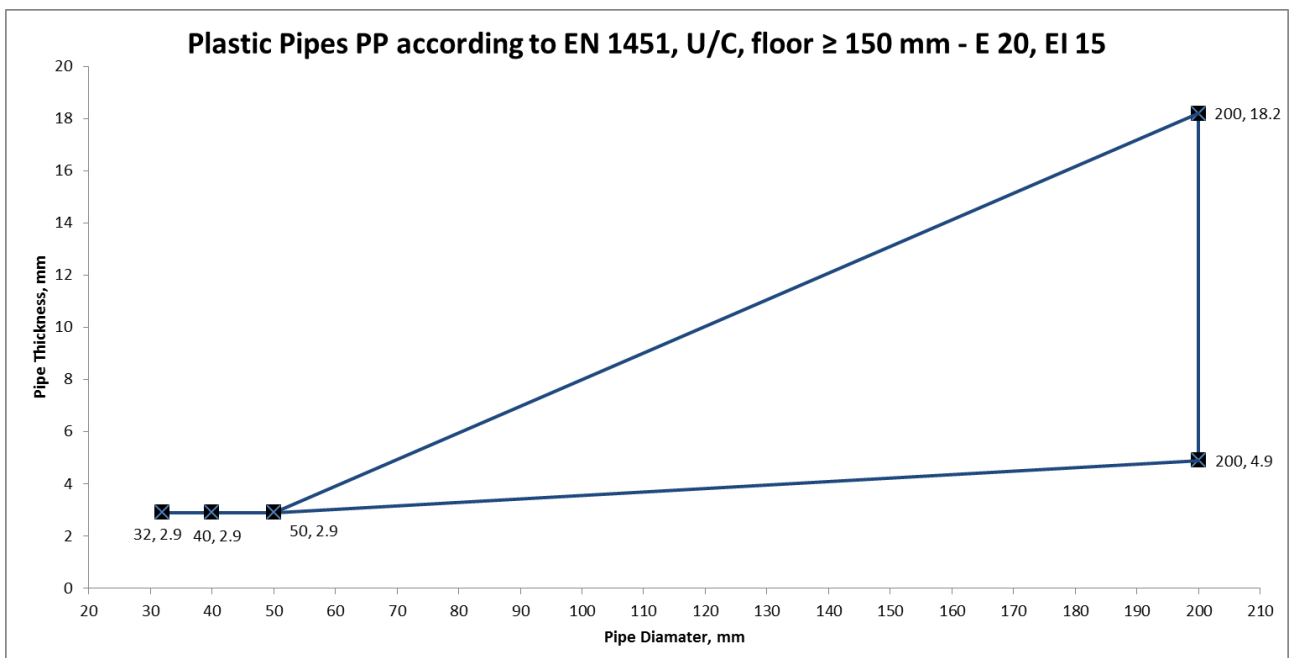

**Declaration of Performance**

SikaSeal®-629 Fire Wrap  
 20971646  
 2020.06 , ver. 01  
 1545

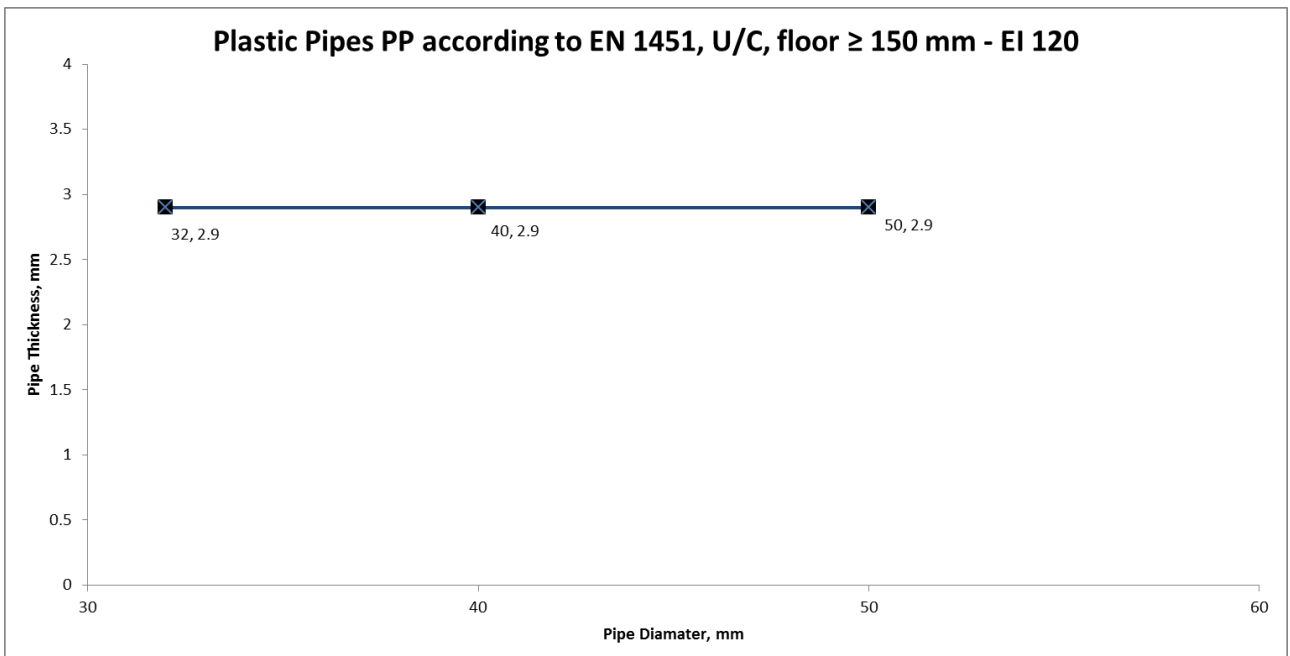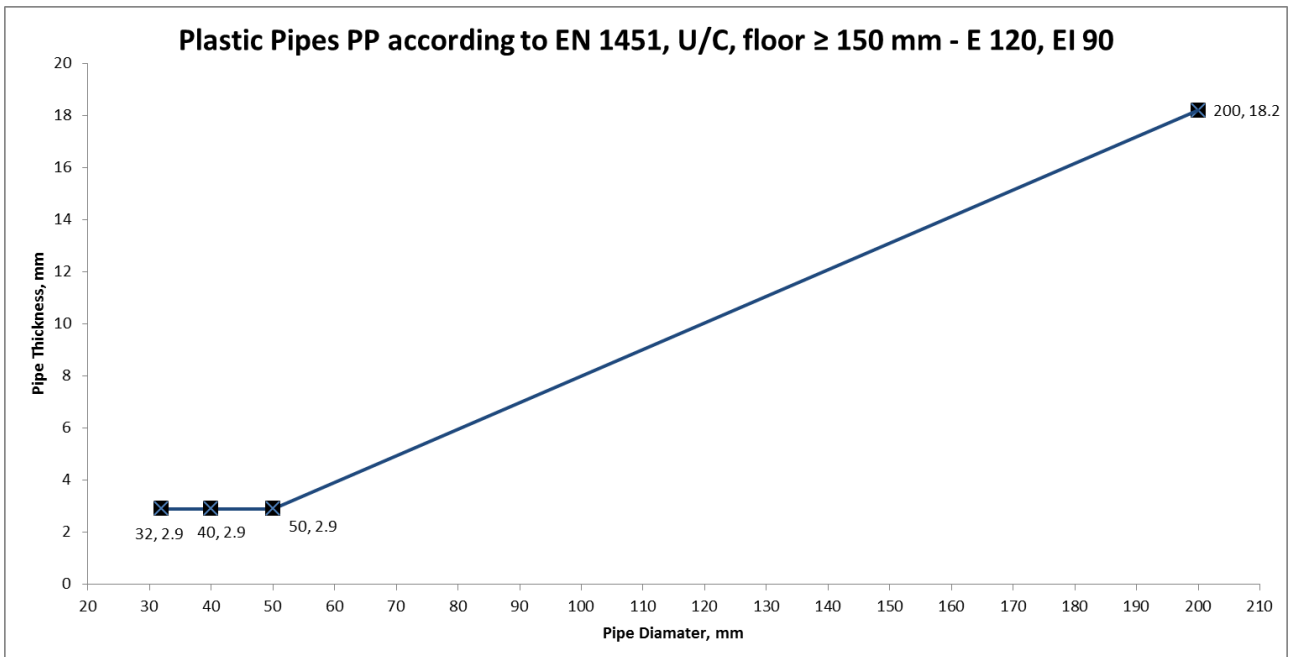

**Declaration of Performance**


SikaSeal®-629 Fire Wrap  
 20971646  
 2020.06 , ver. 01  
 1545



**A.2.1.3 HDPE pipes with SikaSeal® - 629 Fire Wrap installed within both sides of rigid floor**

HDPE pipes according to EN 1519 with SikaSeal® - 629 Fire Wrap.

SikaSeal® - 629 Fire Wrap, Friction Fitted Flush to Both Sides of Rigid Floor (min 150 mm thick) HDPE Pipes			
Penetration Specification	Wrap Size / Number	Annulus Space (mm)	Classification
HDPE Pipe 32 mm ø 2.9 mm wall thickness	1 off 40 mm (W) x 2 mm (T)	4	EI 120 U/C
HDPE Pipe 40 mm ø 2.9 mm wall thickness			
HDPE Pipe 50 mm ø 2.9 mm wall thickness			
HDPE Pipe 200 mm ø 4.9 mm wall thickness	5 off 40 mm (W) x 2 mm (T)	12	
HDPE Pipe 200 mm ø 11.4 mm wall thickness			

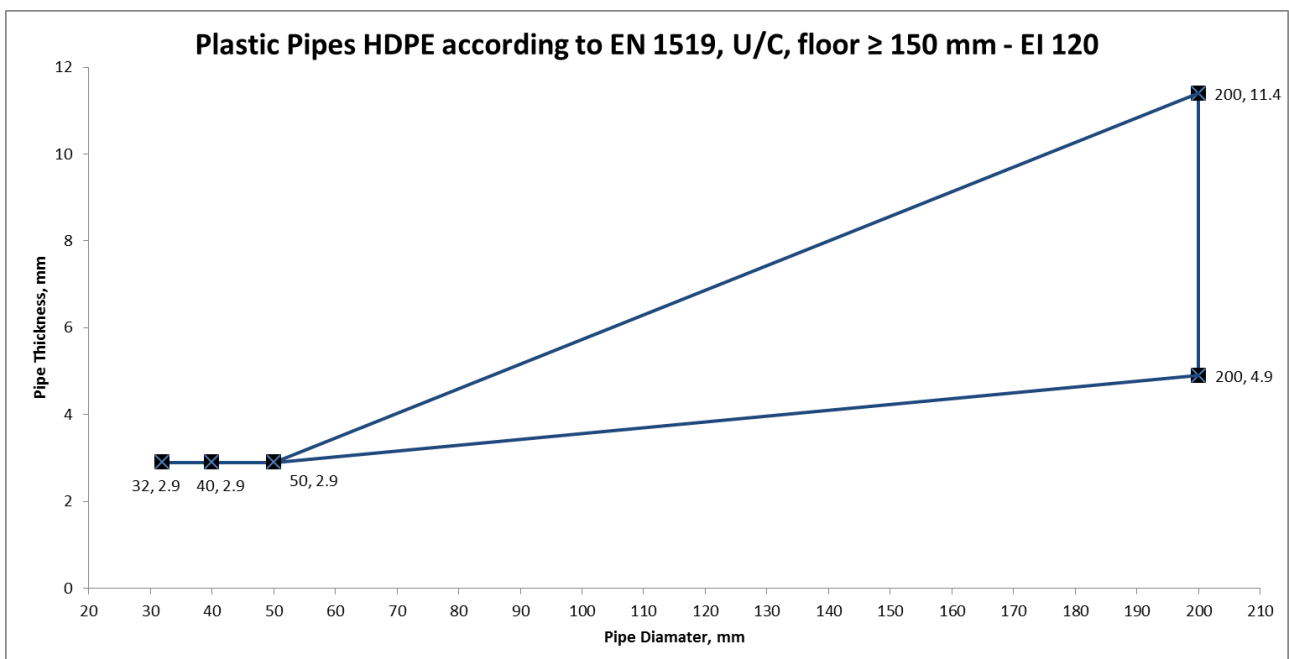

**Declaration of Performance**

SikaSeal®-629 Fire Wrap  
 20971646  
 2020.06 , ver. 01  
 1545






### A.3 Wall construction with thickness of minimum 100 mm

#### A.3.1 Penetration seal with SikaSeal® - 629 Fire Wrap installed within both sides of flexible or rigid wall

Construction details: Combustible pipes installed with a single SikaSeal® - 629 Fire Wrap within both sides. Maximum annular space according to the tables listed in A.3.1.1 to A.3.1.3 filled with Sikacryl® - 621 Fire.

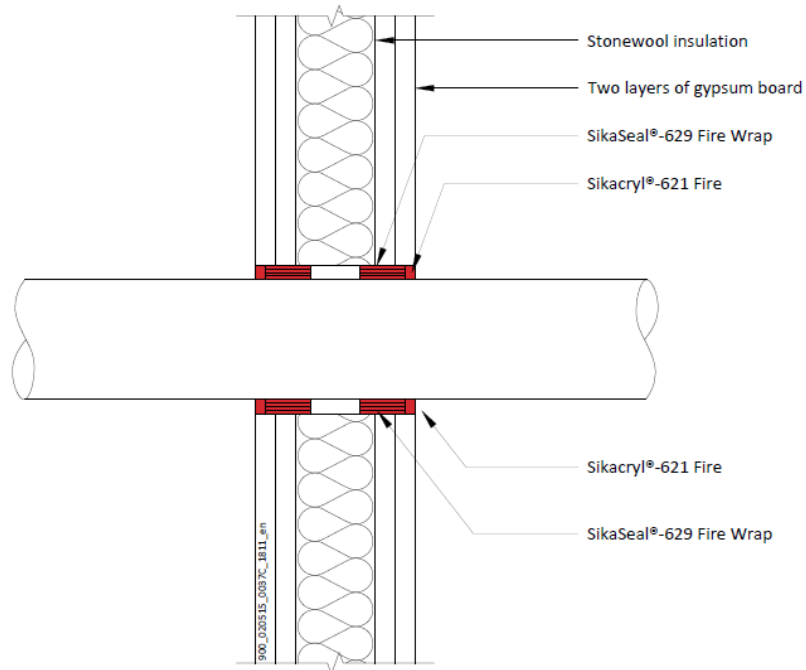


#### Declaration of Performance

SikaSeal®-629 Fire Wrap  
20971646  
2020.06 , ver. 01  
1545

**A.3.1.1 PVC pipes with SikaSeal® - 629 Fire Wrap installed within both sides of flexible or rigid wall**


PVC pipes according to EN 1452 with SikaSeal® - 629 Fire Wrap.

<b>SikaSeal® - 629 Fire Wrap, Friction Fitted Flush to Both Sides of Flexible or Rigid Wall (min 100 mm thick) PVC Pipes</b>			
<b>Penetration Specification</b>	<b>Wrap Size / Number</b>	<b>Annulus Space (mm)</b>	<b>Classification</b>
PVC Pipe 32 mm $\phi$ 1.8 mm wall thickness	1 off 40 mm (W) x 2 mm (T)	4	<b>EI 120 U/C</b>
PVC Pipe 40 mm $\phi$ 1.8 mm wall thickness			
PVC Pipe 50 mm $\phi$ 1.8 mm wall thickness			
PVC Pipe 160 mm $\phi$ 6.2 mm wall thickness	4 off 40 mm (W) x 2 mm (T)	10	<b>EI 90 U/C</b>
PVC Pipe 160 mm $\phi$ 9.5 mm wall thickness			<b>EI 120 U/C</b>
PVC Pipe 200 mm $\phi$ 7.7 mm wall thickness	5 off 40 mm (W) x 2 mm (T)	12	
PVC Pipe 200 mm $\phi$ 9.6 mm wall thickness			

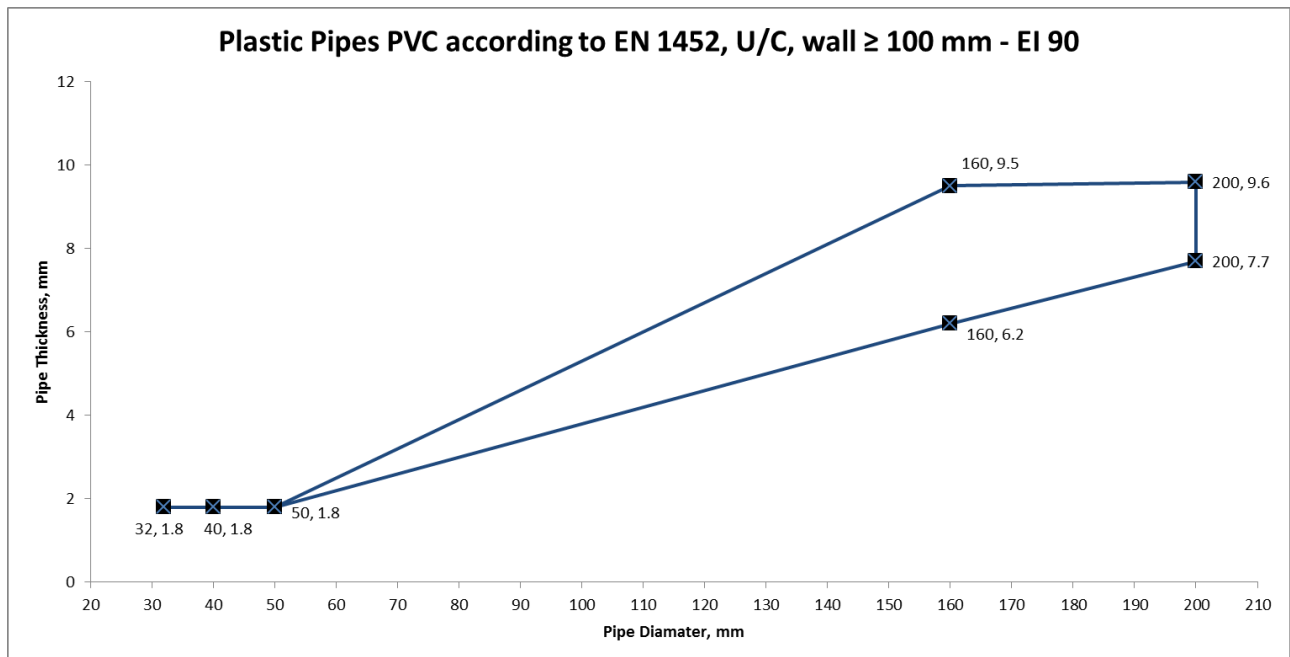

**Declaration of Performance**  
 SikaSeal®-629 Fire Wrap  
 20971646  
 2020.06 , ver. 01  
 1545



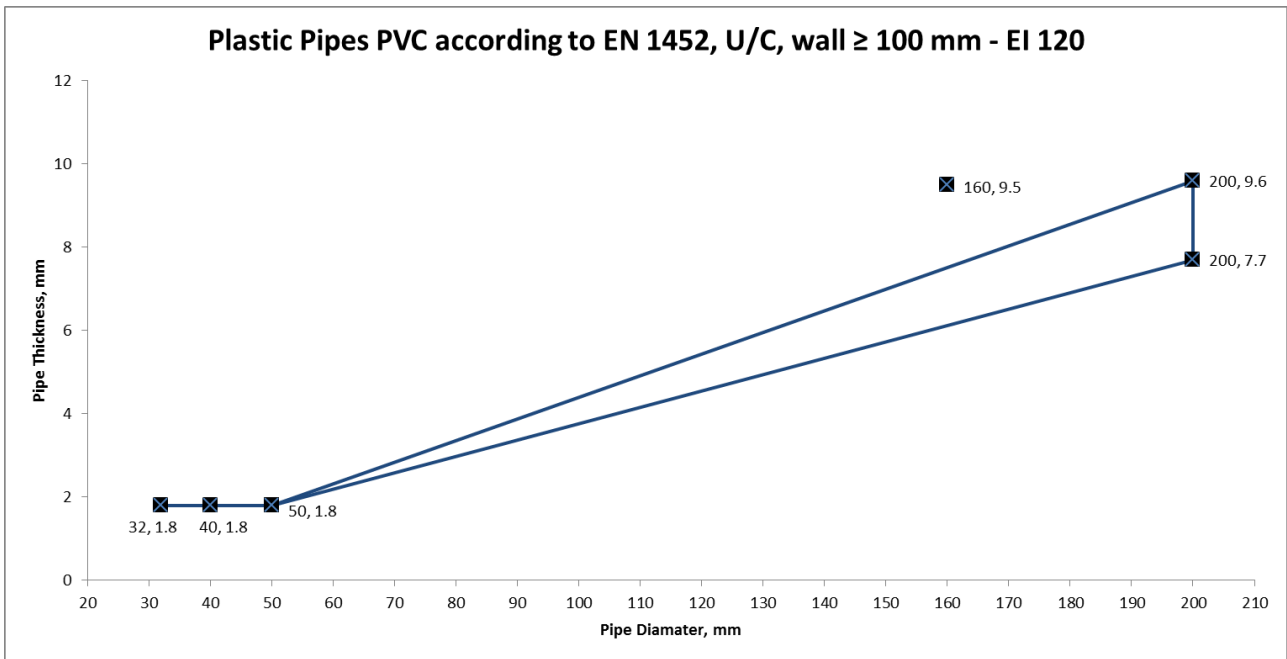


**Declaration of Performance**  
 SikaSeal®-629 Fire Wrap  
 20971646  
 2020.06 , ver. 01  
 1545



**A.3.1.2 PP pipes with SikaSeal® - 629 Fire Wrap installed within both sides of flexible or rigid wall**

PP pipes according to EN 1451 with SikaSeal® - 629 Fire Wrap.

<b>SikaSeal® - 629 Fire Wrap, Friction Fitted Flush to Both Sides of Flexible or Rigid Wall (min 100 mm thick) PP Pipes</b>			
<b>Penetration Specification</b>	<b>Wrap Size / Number</b>	<b>Annulus Space (mm)</b>	<b>Classification</b>
PP Pipe 32 mm $\phi$ 2.9 mm wall thickness	1 off 40 mm (W) x 2 mm (T)	4	<b>EI 120 U/C</b>
PP Pipe 40 mm $\phi$ 2.9 mm wall thickness			
PP Pipe 50 mm $\phi$ 2.9 mm wall thickness			
PP Pipe 160 mm $\phi$ 4.0 mm wall thickness	4 off 40 mm (W) x 2 mm (T)	10	<b>E 120 U/C</b>
PP Pipe 160 mm $\phi$ 14.6 mm wall thickness			<b>EI 120 U/C</b>
PP Pipe 200 mm $\phi$ 4.9 mm wall thickness	5 off 40 mm (W) x 2 mm (T)	12	<b>E 120 U/C</b>
PP Pipe 200 mm $\phi$ 18.2 mm wall thickness			<b>EI 120 U/C</b>
PP Pipe 250 mm $\phi$ 10.1 mm wall thickness	6 off 40 mm (W) x 2 mm (T)	14	<b>E 120 U/C</b> <b>EI 20 U/C</b>

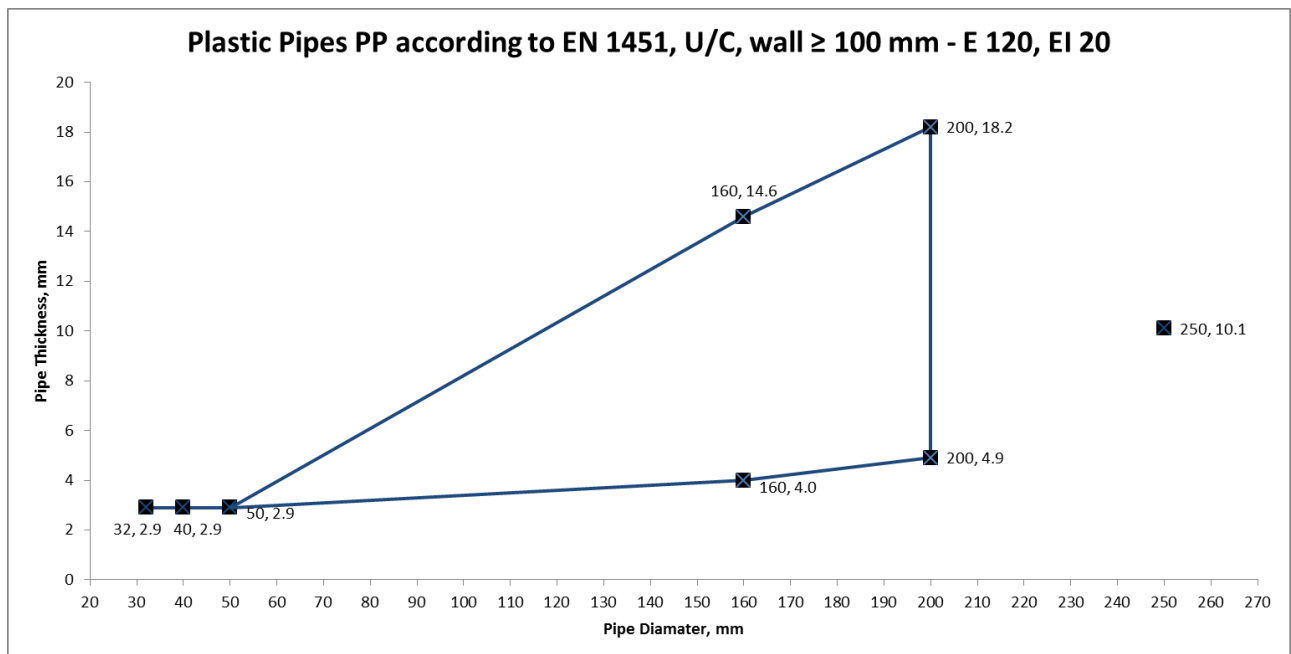


**Declaration of Performance**


SikaSeal®-629 Fire Wrap  
20971646  
2020.06 , ver. 01  
1545



### Plastic Pipes PP according to EN 1451, U/C, wall $\geq$ 100 mm - E 120, EI 90

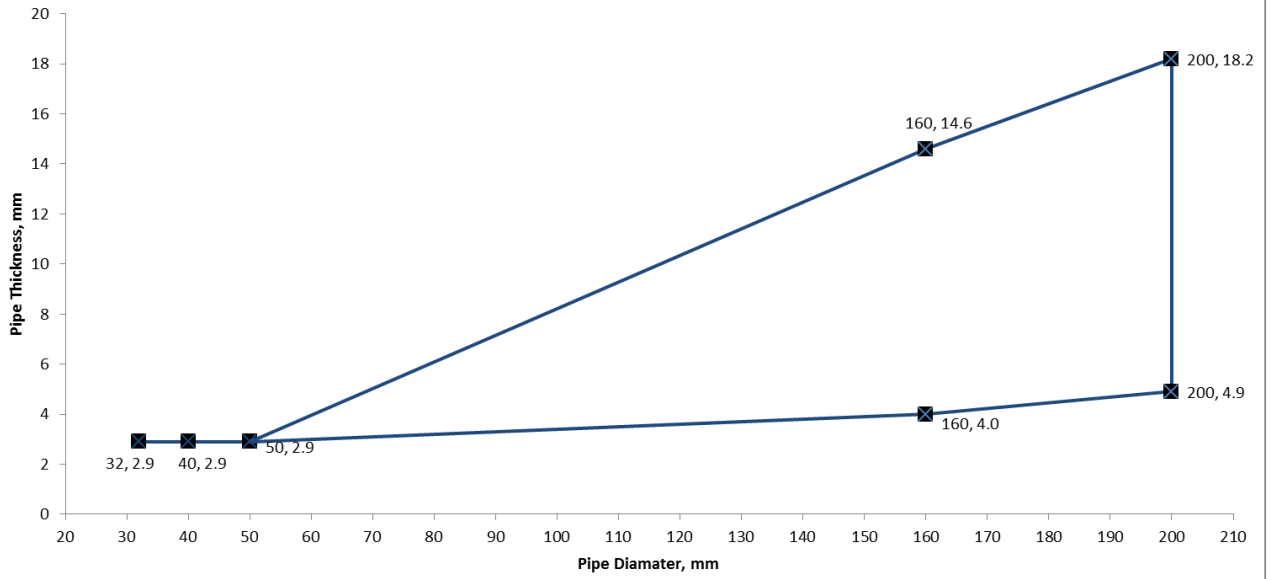

### Plastic Pipes PP according to EN 1451, U/C, wall $\geq$ 100 mm - EI 120

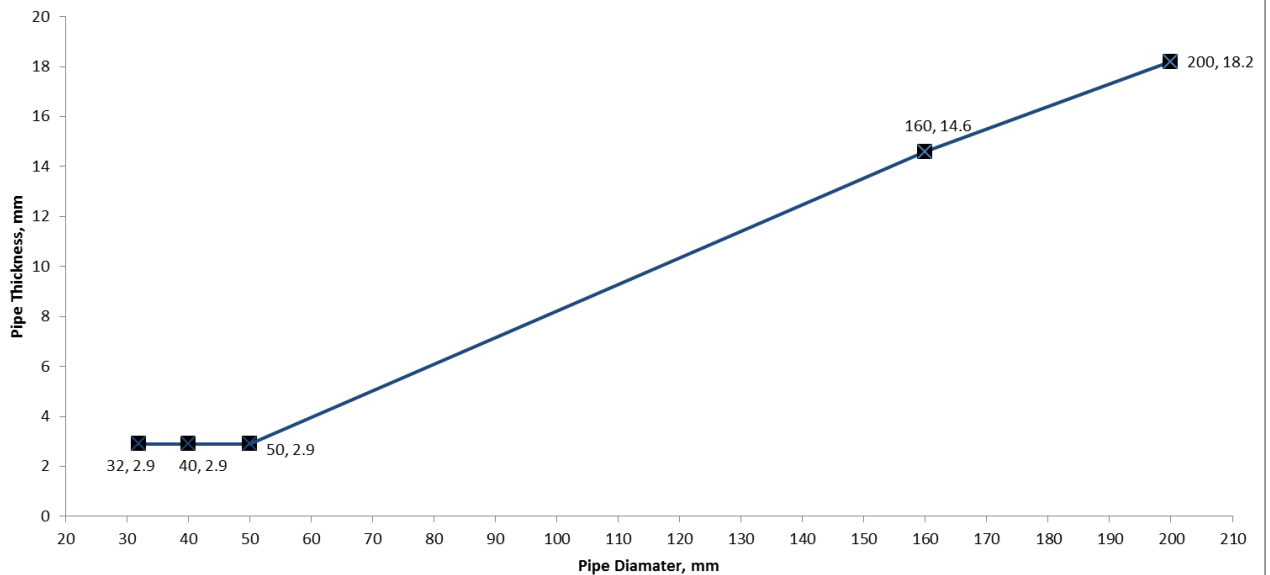

#### Declaration of Performance

SikaSeal®-629 Fire Wrap

20971646


2020.06 , ver. 01

1545

**A.3.1.3 PE pipes with SikaSeal® - 629 Fire Wrap installed within both sides of flexible or rigid wall**

PE pipes according to EN ISO 15494 with SikaSeal® - 629 Fire Wrap.


<b>SikaSeal® - 629 Fire Wrap, Friction Fitted Flush to Both Sides of Flexible or Rigid Wall (min 100 mm thick) PE Pipes</b>			
<b>Penetration Specification</b>	<b>Wrap Size / Number</b>	<b>Annulus Space (mm)</b>	<b>Classification</b>
PE Pipe 32 mm $\phi$ 2.9 mm wall thickness	1 off 40 mm (W) x 2 mm (T)	4	<b>EI 120 U/C</b>
PE Pipe 40 mm $\phi$ 2.9 mm wall thickness			
PE Pipe 50 mm $\phi$ 2.9 mm wall thickness			
PE Pipe 160 mm $\phi$ 4.9 mm wall thickness	4 off 40 mm (W) x 2 mm (T)	10	<b>EI 15 U/C</b>
PE Pipe 160 mm $\phi$ 9.5 mm wall thickness			<b>EI 90 U/C</b>
PE Pipe 200 mm $\phi$ 4.9 mm wall thickness	5 off 40 mm (W) x 2 mm (T)	12	<b>EI 15 U/C</b>
PE Pipe 200 mm $\phi$ 18.4 mm wall thickness			<b>EI 120 U/C</b>

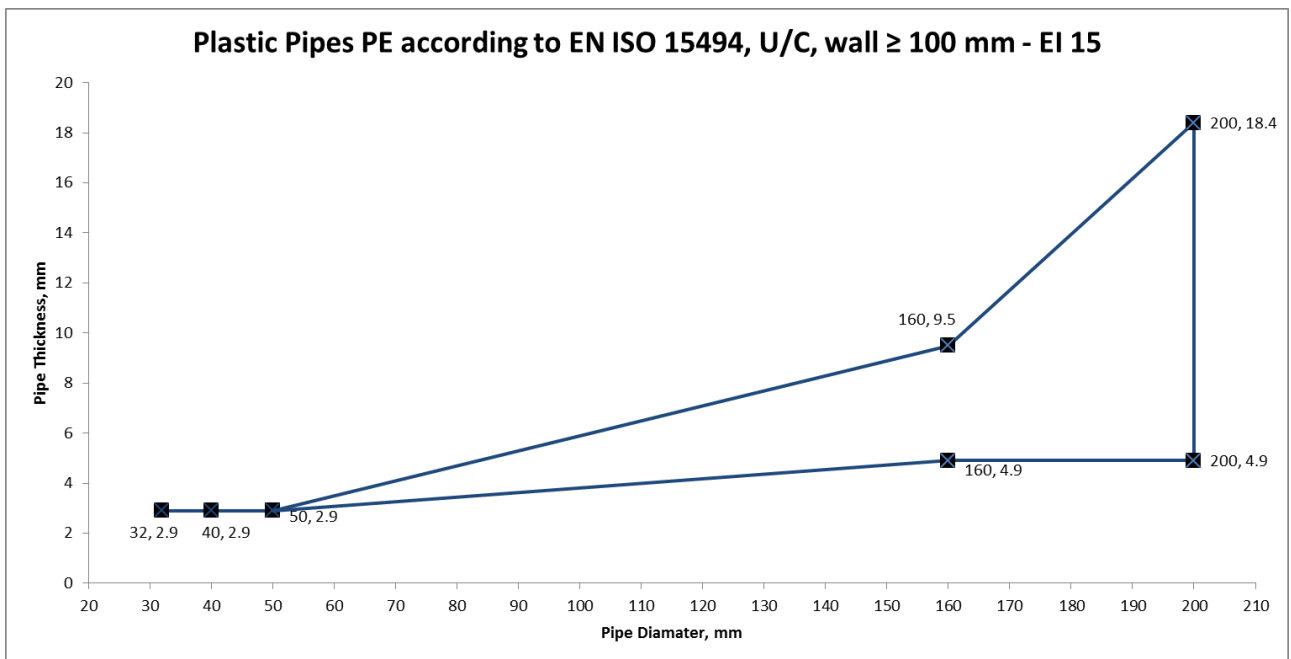


**Declaration of Performance**

SikaSeal®-629 Fire Wrap  
 20971646  
 2020.06 , ver. 01  
 1545

Plastic Pipes PE according to EN ISO 15494, U/C, wall  $\geq$  100 mm - EI 90

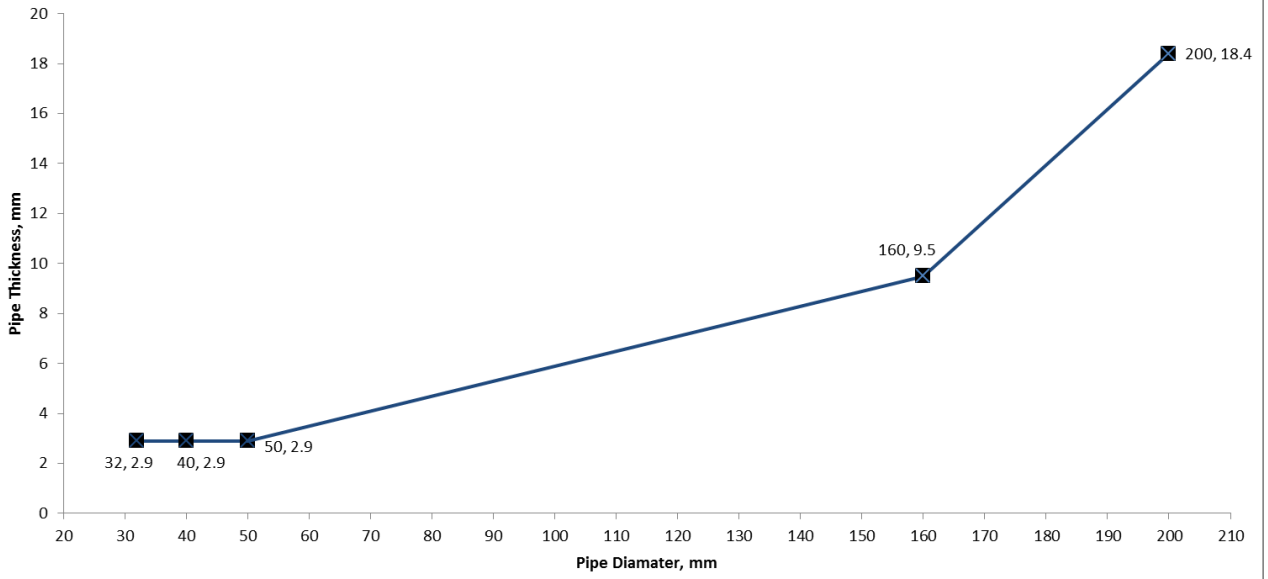

Plastic Pipes PE according to EN ISO 15494, U/C, wall  $\geq$  100 mm - EI 120

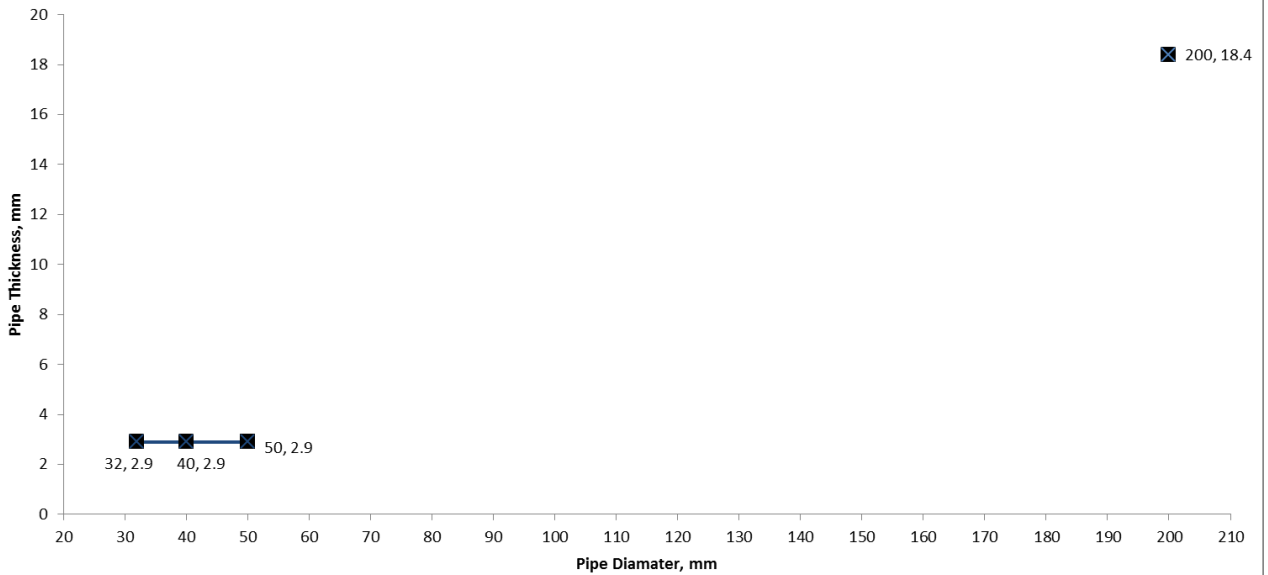

**Declaration of Performance**

SikaSeal®-629 Fire Wrap

20971646

2020.06 , ver. 01

1545



---

**8 APPROPRIATE TECHNICAL DOCUMENTATION AND/OR -  
SPECIFIC TECHNICAL DOCUMENTATION**

---

The performance of the product identified above is in conformity with the set of declared performance/s. This declaration of performance is issued, in accordance with Regulation (EU) No 305/2011, under the sole responsibility of the manufacturer identified above.

Signed for and on behalf of the manufacturer by:

---

Name: Andrew Gillard  
Function: Business Unit Manager  
At Welwyn Garden City on 24 June 2020

Name: Ana Mourato  
Function: Product Manager  
At Welwyn Garden City on 24 June 2020



.....


.....

---

End of information as required by Regulation (EU) No 305/2011



## FULL CE MARKING

 19
Sika Services AG, Zurich, Switzerland
20971646
EAD 350454-00-1104:2017
1121, 2812
Fire stopping and fire sealing products, penetration seals

### Declaration of Performance

SikaSeal®-629 Fire Wrap

20971646

2020.06 , ver. 01

1545

The assessment of fitness for use has been made in accordance with EAD 350454-00-1104

Product Type: Wrap		Intended use: Pipe closure device
Basic requirement for construction work	Basic Requirement	Performance
<b>BWR 1 Mechanical resistance and stability</b>		
	None	Not relevant
<b>BWR 2 Safety in case of fire</b>		
EN 13501-1	Reaction to fire	Class E
EN 13501-2	Resistance to fire	Annex A
<b>BWR 3 Hygiene, Health and the Environment</b>		
EN 1026:2000	Air permeability	No performance determined
EAD 350454-00-1104	Water permeability	No performance determined
Declaration by manufacturer	Release of dangerous substances	Use category IA1, S/W3 Declaration of manufacturer
<b>BWR 4 Safety in use</b>		
EOTA TR 001:2003	Mechanical resistance and stability	No performance determined
EOTA TR 001:2003	Resistance to impact/movement	No performance determined
EOTA TR 001:2003	Adhesion	No performance determined
<b>BWR 5 Protection against noise</b>		
EN 10140-2/ EN ISO 717-1	Airborne sound insulation	No performance determined
<b>BWR 6 Energy, Economy and Heat Retention</b>		
EN 12664, EN 12667 or EN 12939	Thermal properties	No performance determined
EN ISO 12572 EN12086	Water vapour permeability	No performance determined
<b>General aspects relating to fitness for use</b>		
EOTA TR 024:2009	Durability and serviceability	X
<b>BWR 7 Sustainable use of natural resources</b>		
		No performance determined

#### Declaration of Performance

SikaSeal®-629 Fire Wrap  
20971646  
2020.06 , ver. 01  
1545

## Annex A

### Resistance to Fire Classification of SikaSeal® - 629 Fire Wrap

#### A.1 Intumescent Thickness


The permitted thickness of the intumescent material for various ranges of pipe diameters:

Intumescent Thickness	
Pipe Diameter	Intumescent Material
ø 32 mm - ø 50 mm	1 off 40 mm (W) x 2 (T)
ø 50 mm - ø 82 mm	2 off 40 mm (W) x 2 (T)
ø 82 mm - ø 115 mm	3 off 40 mm (W) x 2 (T)
ø 115 mm - ø 160 mm	4 off 40 mm (W) x 2 (T)
ø 160 mm - ø 200 mm	5 off 40 mm (W) x 2 (T)
ø 200 mm - ø 250 mm	6 off 40 mm (W) x 2 (T)

#### A.2 Floor construction with thickness of minimum 150 mm

##### A.2.1 Penetration seal with SikaSeal® - 629 Fire Wrap installed within both sides of rigid floor

Construction details: Combustible pipes installed with a single SikaSeal® - 629 Fire Wrap within both sides. Maximum annular space according to the tables listed in A.2.1.1 to A.2.1.3 filled with Sikacryl® - 621 Fire.

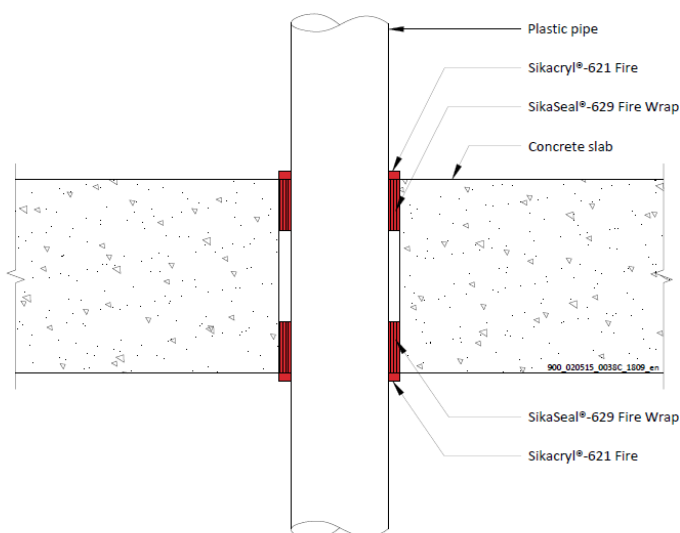


#### Declaration of Performance

SikaSeal®-629 Fire Wrap  
 20971646  
 2020.06 , ver. 01  
 1545

**A.2.1.1 PVC-U pipes with SikaSeal® - 629 Fire Wrap installed within both sides of rigid floor**



PVC pipes according to EN 1452 with SikaSeal® - 629 Fire Wrap.

SikaSeal® - 629 Fire Wrap, Friction Fitted Flush to Both Sides of Rigid Floor (min 150 mm thick) PVC Pipes			
Penetration Specification	Wrap Size / Number	Annulus Space (mm)	Classification
PVC Pipe 32 mm $\phi$ 1.8 mm wall thickness	1 off 40 mm (W) x 2 mm (T)	4	EI 120 U/C
PVC Pipe 40 mm $\phi$ 1.8 mm wall thickness			
PVC Pipe 50 mm $\phi$ 1.8 mm wall thickness			
PVC Pipe 200 mm $\phi$ 7.7 mm wall thickness	5 off 40 mm (W) x 2 mm (T)	12	E 120 U/C
PVC Pipe 200 mm $\phi$ 9.6 mm wall thickness			EI 90 U/C
			EI 60 U/C

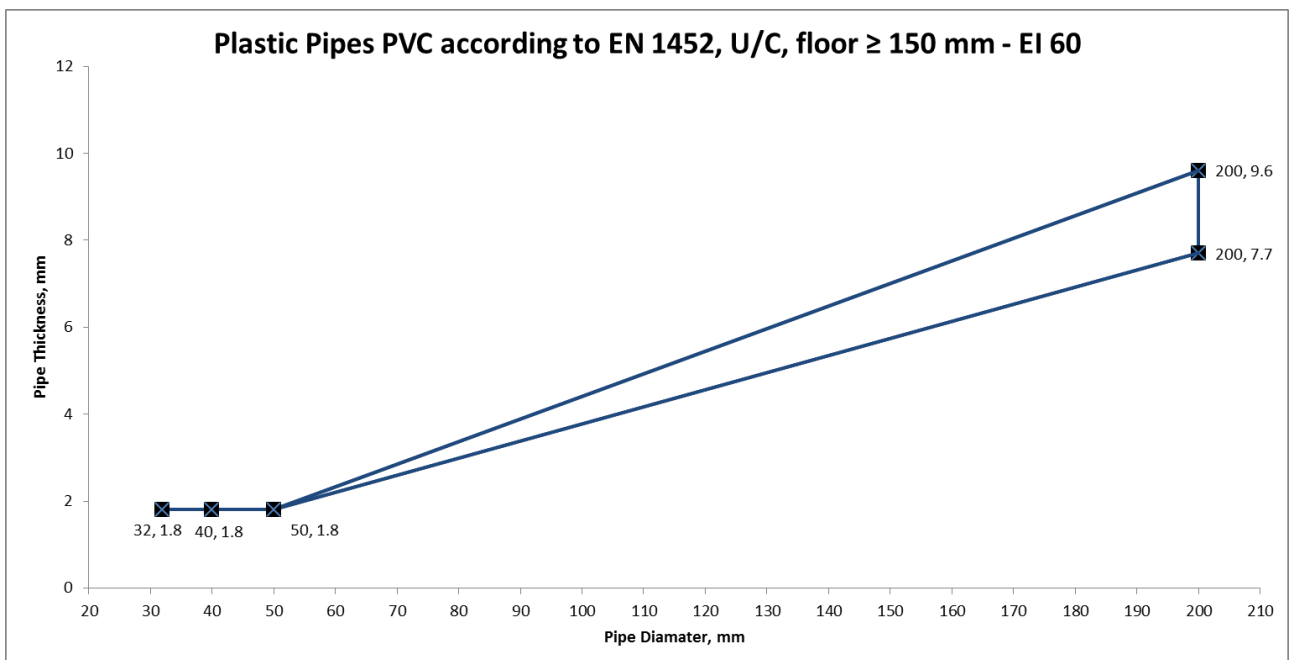

**Declaration of Performance**

SikaSeal®-629 Fire Wrap  
 20971646  
 2020.06 , ver. 01  
 1545

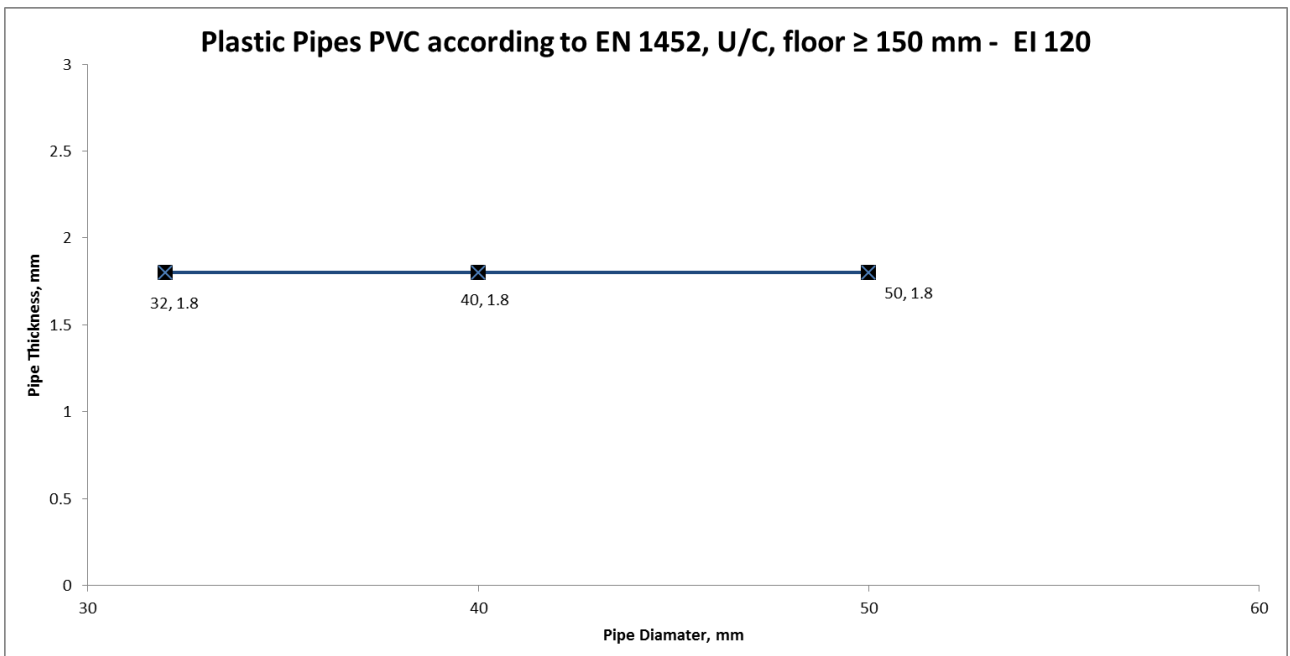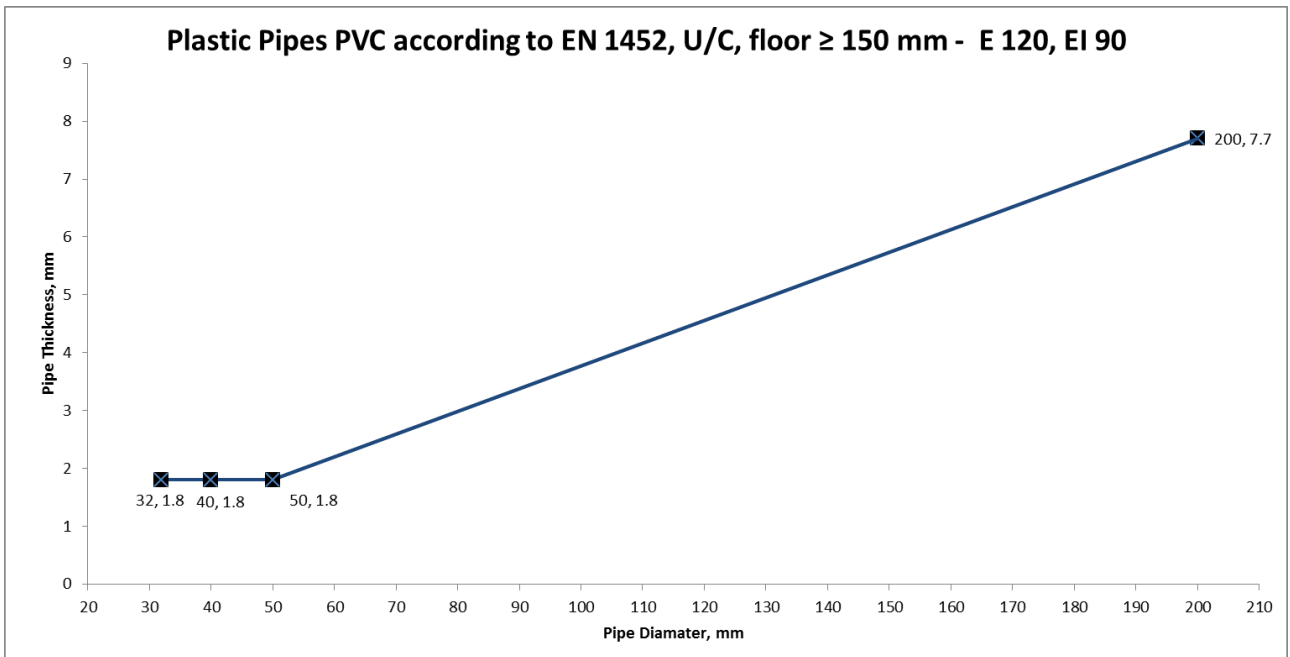

**Declaration of Performance**


SikaSeal®-629 Fire Wrap  
 20971646  
 2020.06 , ver. 01  
 1545



**A.2.1.2 PP pipes with SikaSeal® - 629 Fire Wrap installed within both sides of rigid floor**



PP pipes according to EN 1451 with SikaSeal® - 629 Fire Wrap.

SikaSeal® - 629 Fire Wrap, Friction Fitted Flush to Both Sides of Rigid Floor (min 150 mm thick) PP Pipes			
Penetration Specification	Wrap Size / Number	Annulus Space (mm)	Classification
PP Pipe 32 mm $\phi$ 2.9 mm wall thickness	1 off 40 mm (W) x 2 mm (T)	4	EI 120 U/C
PP Pipe 40 mm $\phi$ 2.9 mm wall thickness			
PP Pipe 50 mm $\phi$ 2.9 mm wall thickness			
PP Pipe 200 mm $\phi$ 4.9 mm wall thickness	5 off 40 mm (W) x 2 mm (T)	12	E 20 U/C
PP Pipe 200 mm $\phi$ 18.2 mm wall thickness			EI 15 U/C
			E 120 U/C
			EI 90 U/C

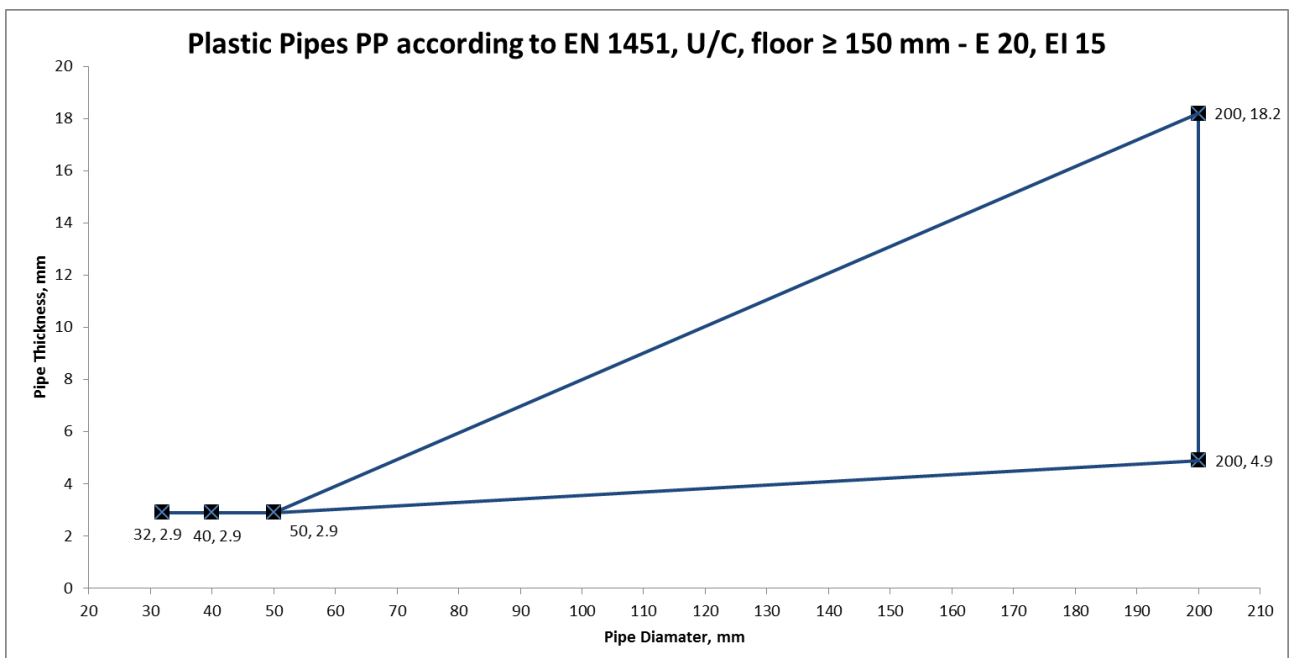

**Declaration of Performance**

SikaSeal®-629 Fire Wrap  
 20971646  
 2020.06 , ver. 01  
 1545

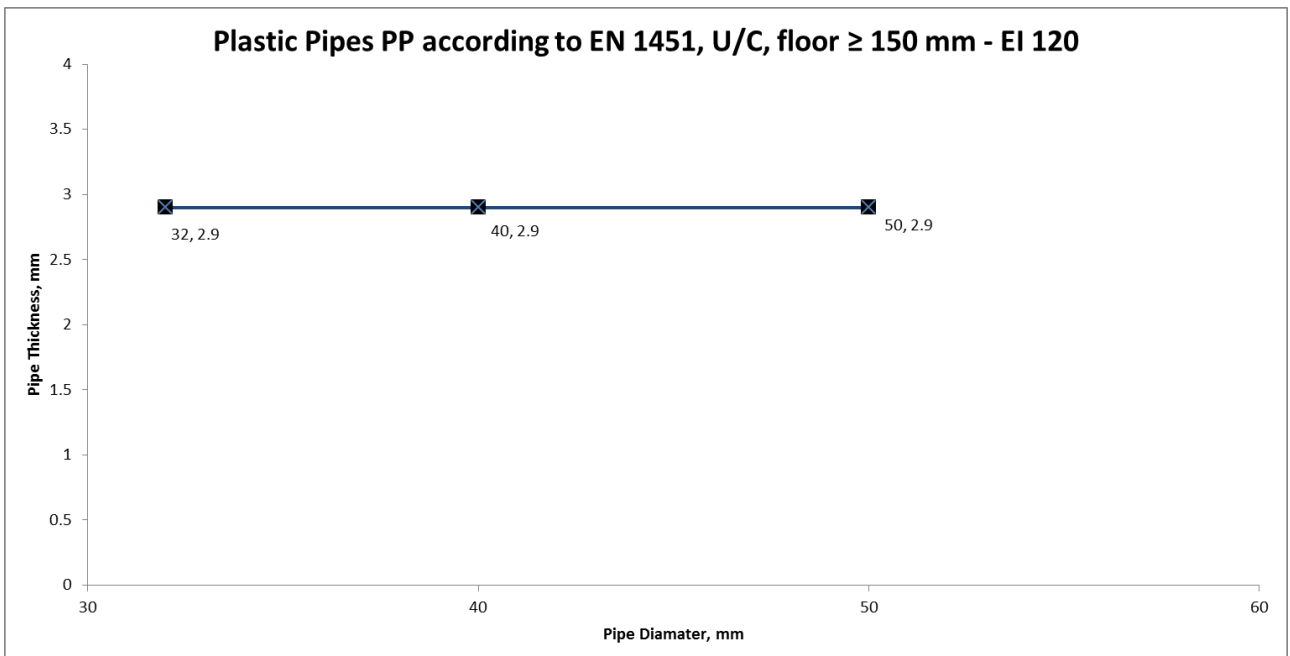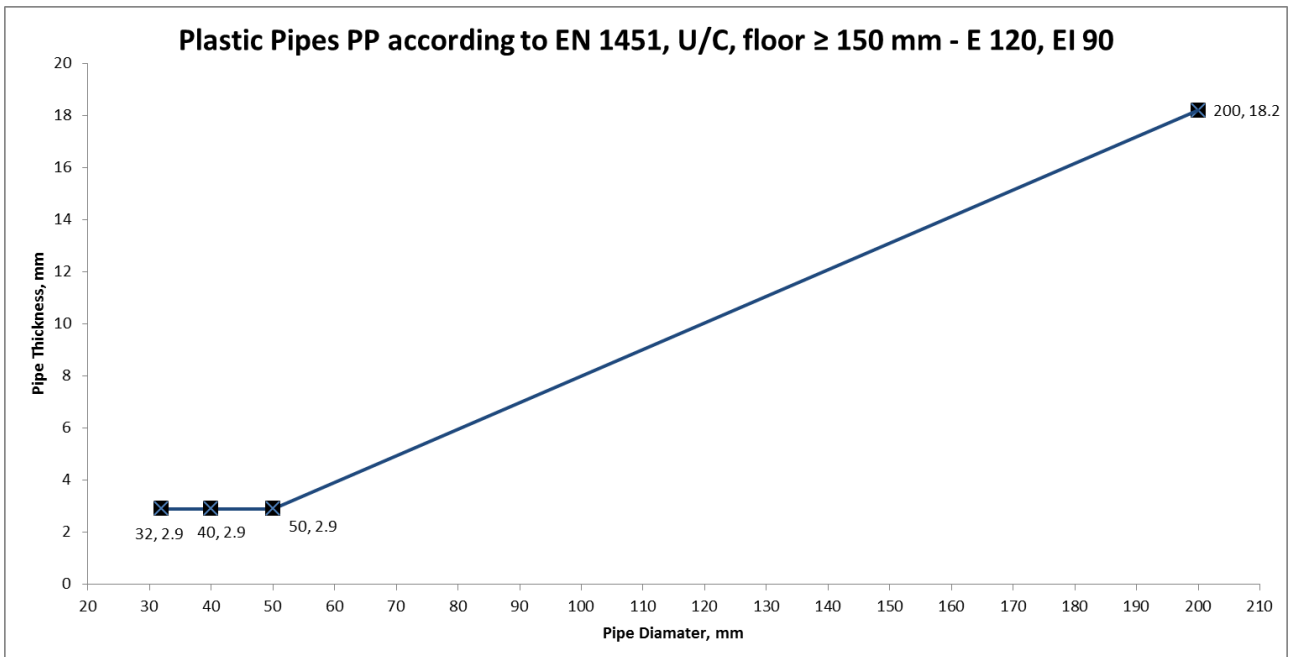

**Declaration of Performance**


SikaSeal®-629 Fire Wrap  
 20971646  
 2020.06 , ver. 01  
 1545



**A.2.1.3 HDPE pipes with SikaSeal® - 629 Fire Wrap installed within both sides of rigid floor**

HDPE pipes according to EN 1519 with SikaSeal® - 629 Fire Wrap.

SikaSeal® - 629 Fire Wrap, Friction Fitted Flush to Both Sides of Rigid Floor (min 150 mm thick) HDPE Pipes			
Penetration Specification	Wrap Size / Number	Annulus Space (mm)	Classification
HDPE Pipe 32 mm ø 2.9 mm wall thickness	1 off 40 mm (W) x 2 mm (T)	4	EI 120 U/C
HDPE Pipe 40 mm ø 2.9 mm wall thickness			
HDPE Pipe 50 mm ø 2.9 mm wall thickness			
HDPE Pipe 200 mm ø 4.9 mm wall thickness	5 off 40 mm (W) x 2 mm (T)	12	
HDPE Pipe 200 mm ø 11.4 mm wall thickness			

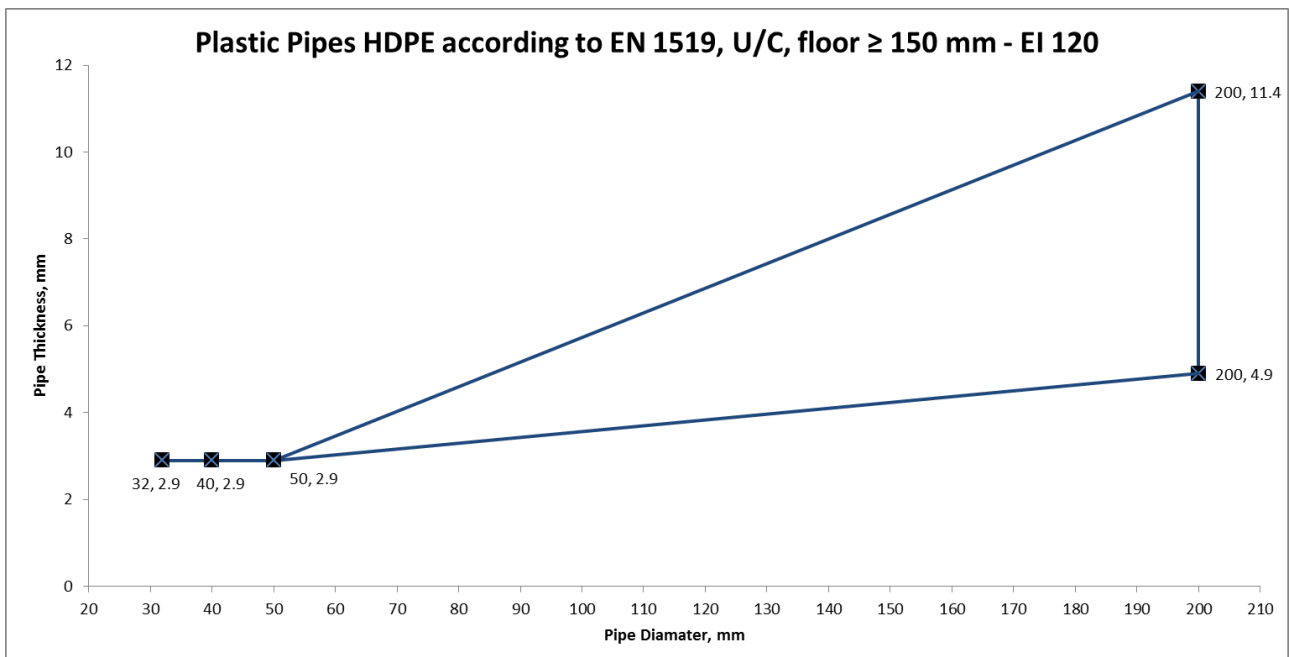

**Declaration of Performance**


SikaSeal®-629 Fire Wrap  
 20971646  
 2020.06 , ver. 01  
 1545



### A.3 Wall construction with thickness of minimum 100 mm

#### A.3.1 Penetration seal with SikaSeal® - 629 Fire Wrap installed within both sides of flexible or rigid wall

Construction details: Combustible pipes installed with a single SikaSeal® - 629 Fire Wrap within both sides. Maximum annular space according to the tables listed in A.3.1.1 to A.3.1.3 filled with Sikacryl® - 621 Fire.

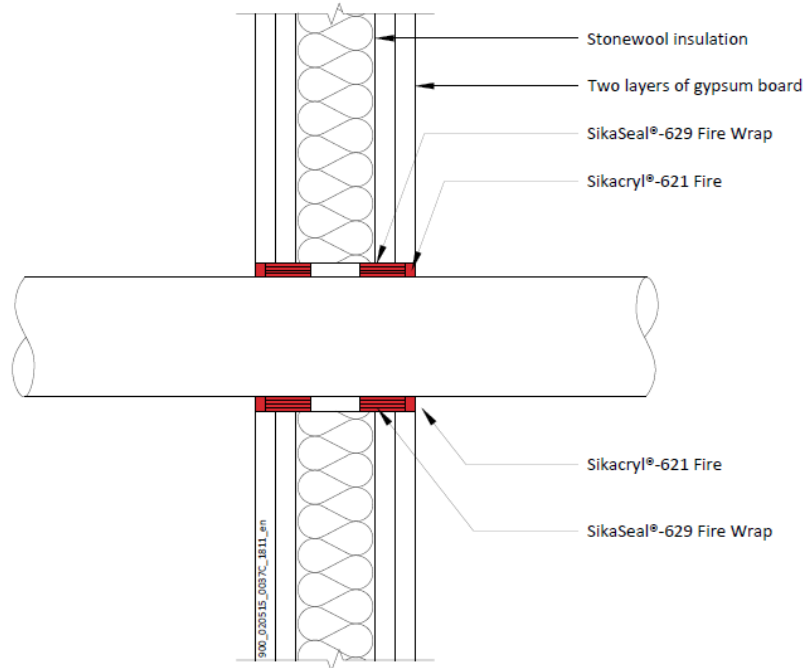


#### Declaration of Performance

SikaSeal®-629 Fire Wrap  
20971646  
2020.06 , ver. 01  
1545

**A.3.1.1 PVC pipes with SikaSeal® - 629 Fire Wrap installed within both sides of flexible or rigid wall**


PVC pipes according to EN 1452 with SikaSeal® - 629 Fire Wrap.

<b>SikaSeal® - 629 Fire Wrap, Friction Fitted Flush to Both Sides of Flexible or Rigid Wall (min 100 mm thick) PVC Pipes</b>			
<b>Penetration Specification</b>	<b>Wrap Size / Number</b>	<b>Annulus Space (mm)</b>	<b>Classification</b>
PVC Pipe 32 mm $\phi$ 1.8 mm wall thickness	1 off 40 mm (W) x 2 mm (T)	4	<b>EI 120 U/C</b>
PVC Pipe 40 mm $\phi$ 1.8 mm wall thickness			
PVC Pipe 50 mm $\phi$ 1.8 mm wall thickness			
PVC Pipe 160 mm $\phi$ 6.2 mm wall thickness	4 off 40 mm (W) x 2 mm (T)	10	<b>EI 90 U/C</b>
PVC Pipe 160 mm $\phi$ 9.5 mm wall thickness			<b>EI 120 U/C</b>
PVC Pipe 200 mm $\phi$ 7.7 mm wall thickness	5 off 40 mm (W) x 2 mm (T)	12	
PVC Pipe 200 mm $\phi$ 9.6 mm wall thickness			

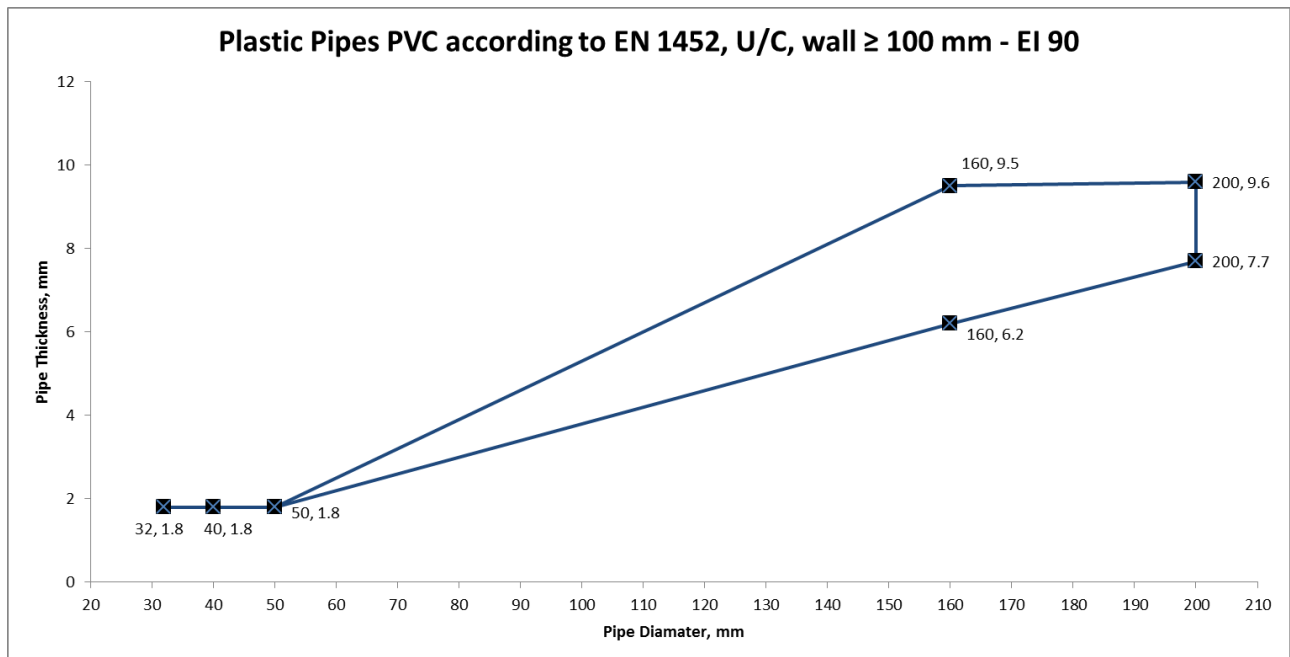

**Declaration of Performance**  
 SikaSeal®-629 Fire Wrap  
 20971646  
 2020.06 , ver. 01  
 1545



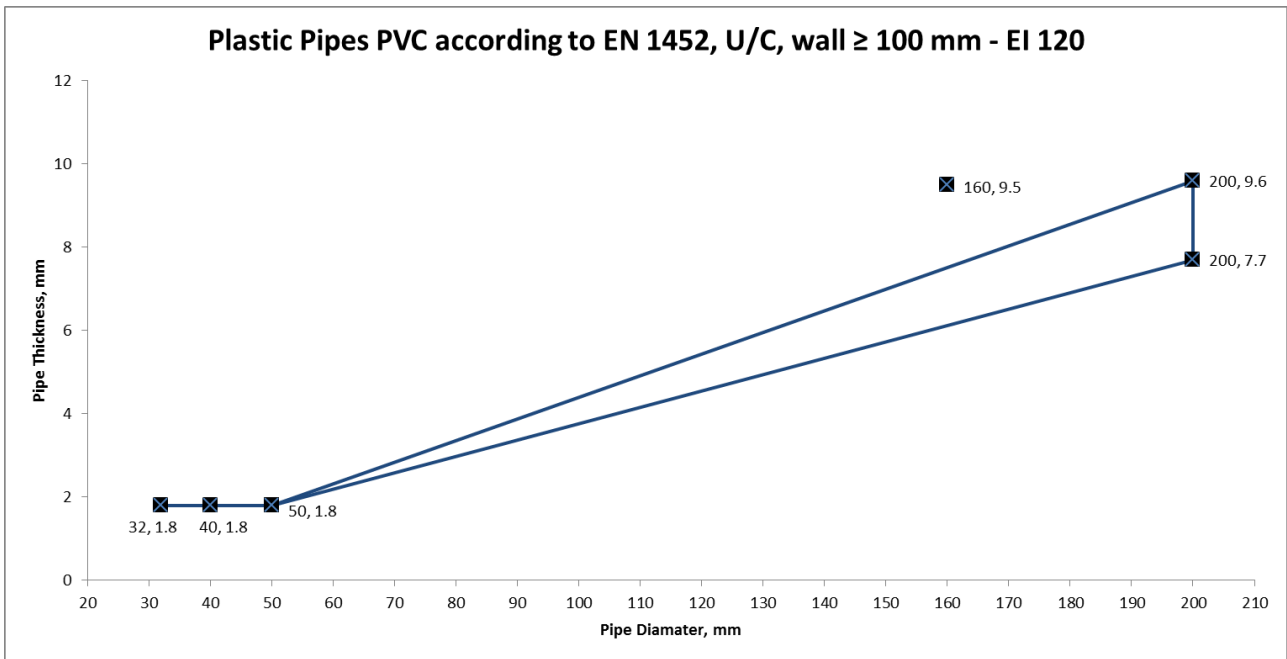


**Declaration of Performance**  
 SikaSeal®-629 Fire Wrap  
 20971646  
 2020.06 , ver. 01  
 1545



**A.3.1.2 PP pipes with SikaSeal® - 629 Fire Wrap installed within both sides of flexible or rigid wall**

PP pipes according to EN 1451 with SikaSeal® - 629 Fire Wrap.

<b>SikaSeal® - 629 Fire Wrap, Friction Fitted Flush to Both Sides of Flexible or Rigid Wall (min 100 mm thick) PP Pipes</b>			
<b>Penetration Specification</b>	<b>Wrap Size / Number</b>	<b>Annulus Space (mm)</b>	<b>Classification</b>
PP Pipe 32 mm $\phi$ 2.9 mm wall thickness	1 off 40 mm (W) x 2 mm (T)	4	EI 120 U/C
PP Pipe 40 mm $\phi$ 2.9 mm wall thickness			
PP Pipe 50 mm $\phi$ 2.9 mm wall thickness			
PP Pipe 160 mm $\phi$ 4.0 mm wall thickness	4 off 40 mm (W) x 2 mm (T)	10	E 120 U/C
PP Pipe 160 mm $\phi$ 14.6 mm wall thickness			EI 120 U/C
PP Pipe 200 mm $\phi$ 4.9 mm wall thickness	5 off 40 mm (W) x 2 mm (T)	12	E 120 U/C
PP Pipe 200 mm $\phi$ 18.2 mm wall thickness			EI 120 U/C
PP Pipe 250 mm $\phi$ 10.1 mm wall thickness	6 off 40 mm (W) x 2 mm (T)	14	E 120 U/C EI 20 U/C

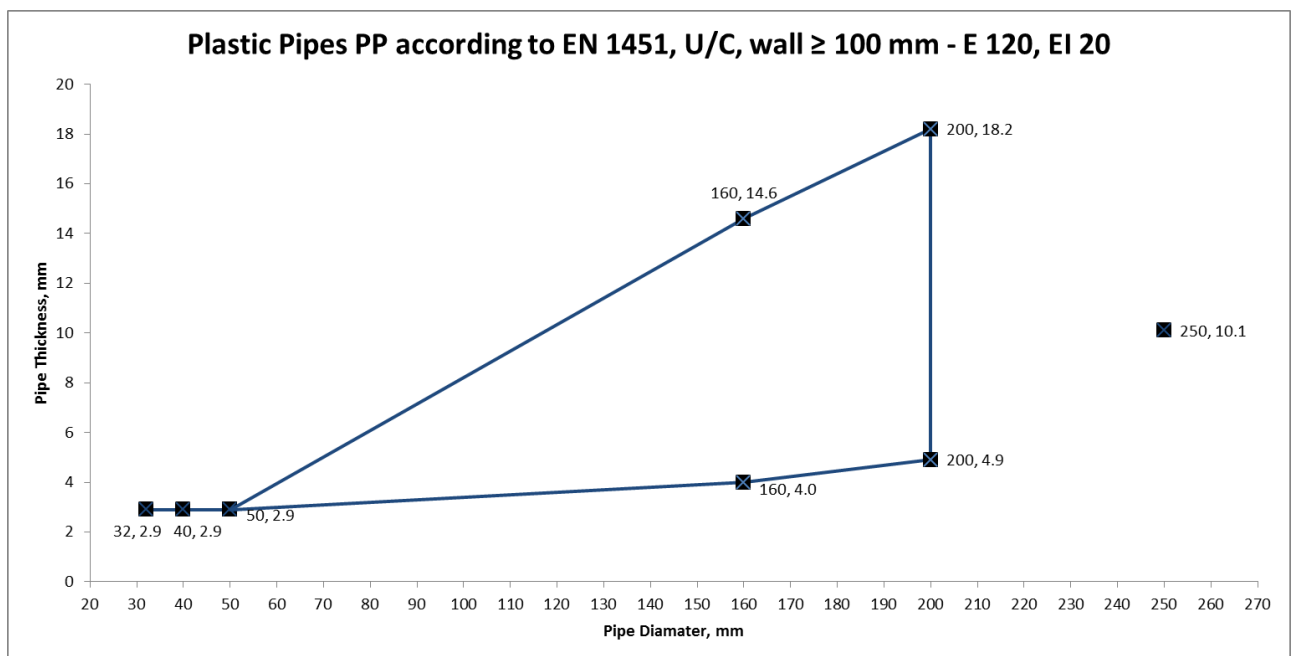


**Declaration of Performance**


SikaSeal®-629 Fire Wrap  
 20971646  
 2020.06 , ver. 01  
 1545



### Plastic Pipes PP according to EN 1451, U/C, wall $\geq$ 100 mm - E 120, EI 90

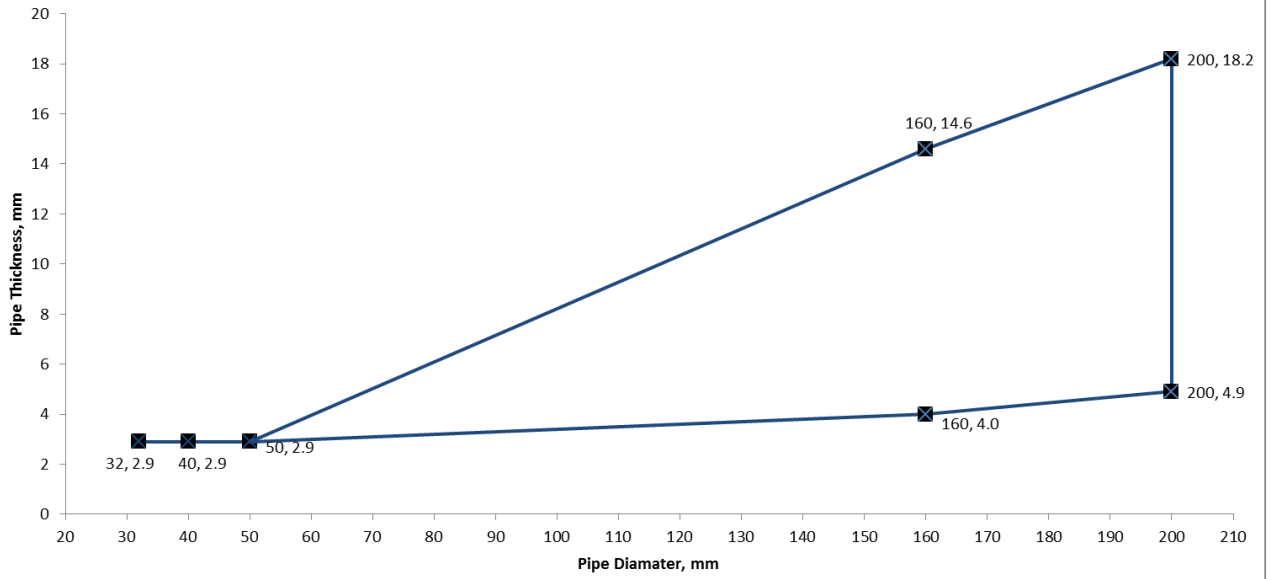

### Plastic Pipes PP according to EN 1451, U/C, wall $\geq$ 100 mm - EI 120

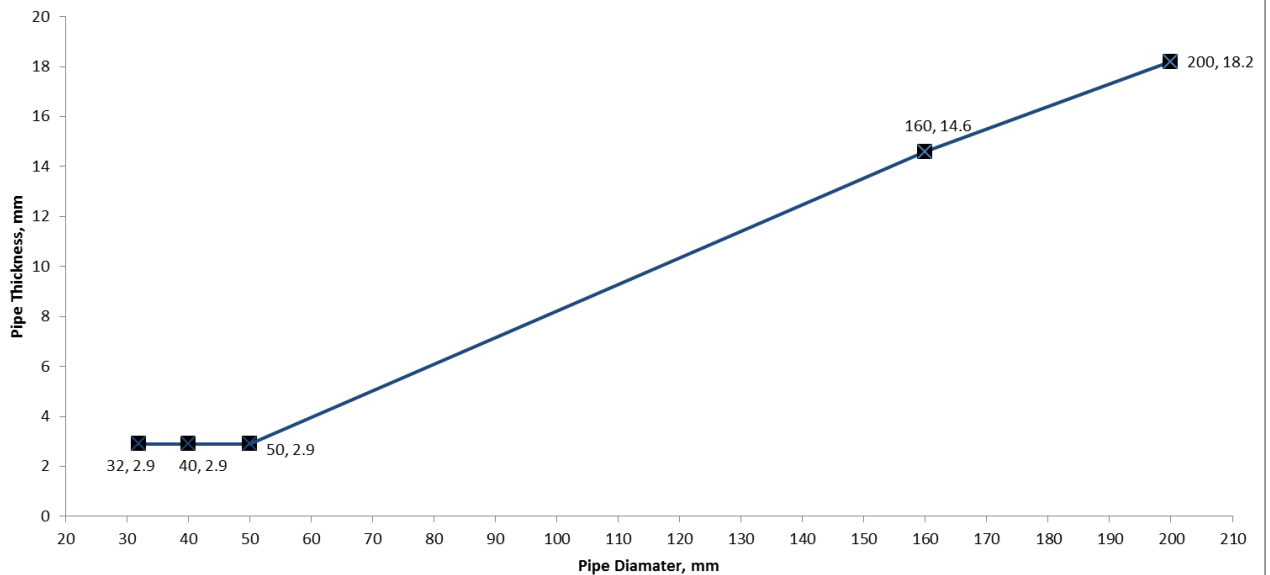

#### Declaration of Performance

SikaSeal®-629 Fire Wrap

20971646


2020.06 , ver. 01

1545

### A.3.1.3 PE pipes with SikaSeal® - 629 Fire Wrap installed within both sides of flexible or rigid wall

PE pipes according to EN ISO 15494 with SikaSeal® - 629 Fire Wrap.


SikaSeal® - 629 Fire Wrap, Friction Fitted Flush to Both Sides of Flexible or Rigid Wall (min 100 mm thick) PE Pipes			
Penetration Specification	Wrap Size / Number	Annulus Space (mm)	Classification
PE Pipe 32 mm $\phi$ 2.9 mm wall thickness	1 off 40 mm (W) x 2 mm (T)	4	EI 120 U/C
PE Pipe 40 mm $\phi$ 2.9 mm wall thickness			
PE Pipe 50 mm $\phi$ 2.9 mm wall thickness			
PE Pipe 160 mm $\phi$ 4.9 mm wall thickness	4 off 40 mm (W) x 2 mm (T)	10	EI 15 U/C
PE Pipe 160 mm $\phi$ 9.5 mm wall thickness			EI 90 U/C
PE Pipe 200 mm $\phi$ 4.9 mm wall thickness	5 off 40 mm (W) x 2 mm (T)	12	EI 15 U/C
PE Pipe 200 mm $\phi$ 18.4 mm wall thickness			EI 120 U/C

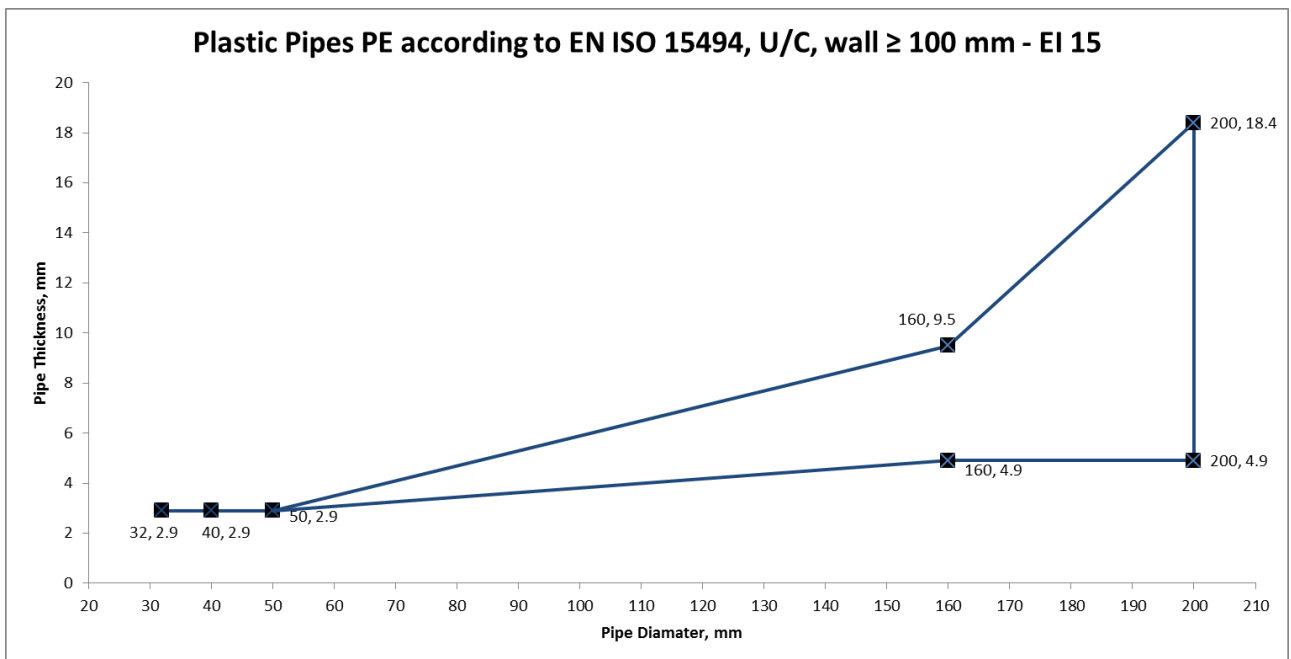


#### Declaration of Performance

SikaSeal®-629 Fire Wrap  
 20971646  
 2020.06 , ver. 01  
 1545

### Plastic Pipes PE according to EN ISO 15494, U/C, wall $\geq$ 100 mm - EI 90

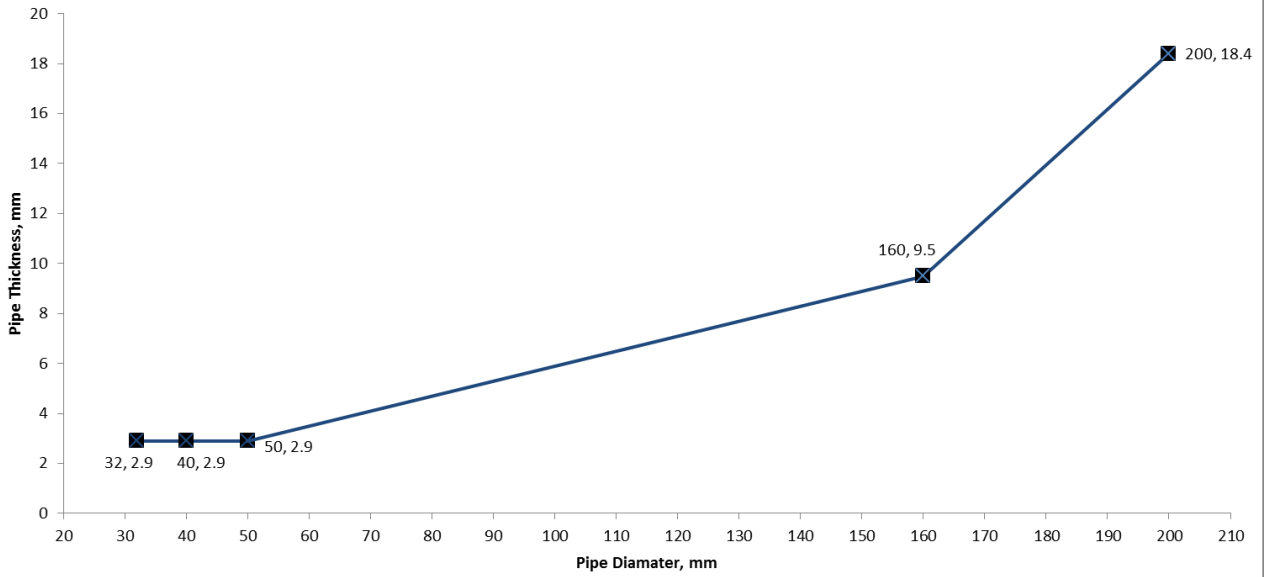

### Plastic Pipes PE according to EN ISO 15494, U/C, wall $\geq$ 100 mm - EI 120

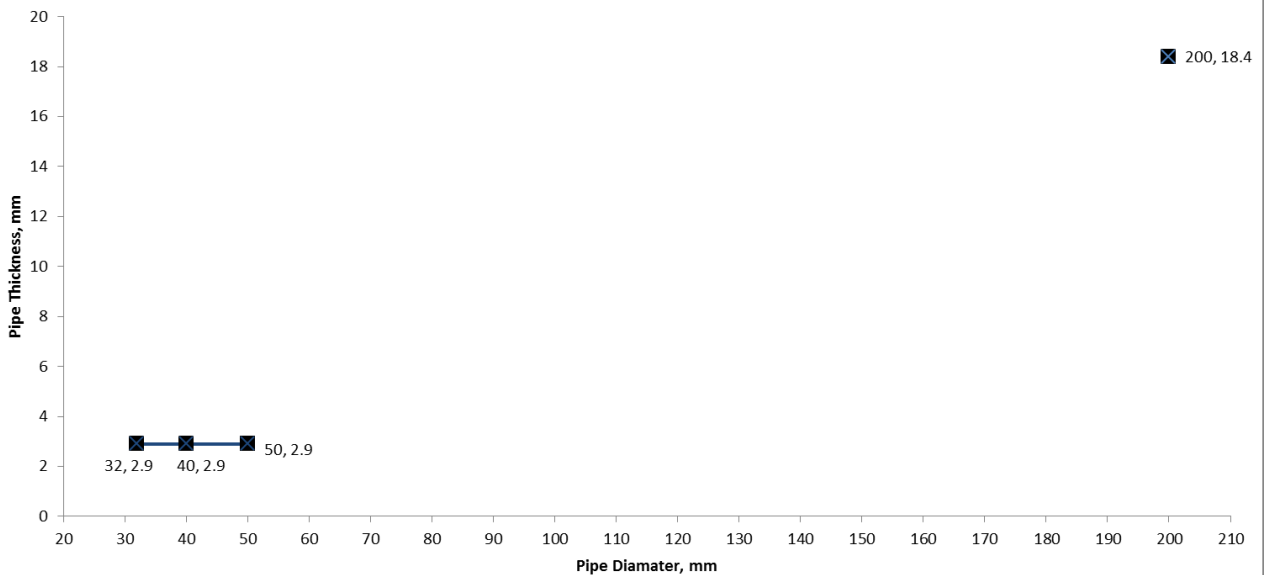

[dop.sika.com](http://dop.sika.com)

#### Declaration of Performance

SikaSeal®-629 Fire Wrap

20971646

2020.06 , ver. 01

1545

## CE MARKING TO BE PLACED ON THE LABEL

 19
Sika Services AG, Zurich, Switzerland
20971646
EAD 350454-00-1104:2017
1121, 2812
Fire stopping and fire sealing products, penetration seals
For details see accompanying documents
<a href="http://dop.sika.com">dop.sika.com</a>

### ECOLOGY, HEALTH AND SAFETY INFORMATION (REACH)

This product is an article as defined in article 3 of regulation (EC) No 1907/2006 (REACH). It contains no substances which are intended to be released from the article under normal or reasonably foreseeable conditions of use. A safety data sheet following article 31 of the same regulation is not needed to bring the product to the market, to transport or to use it. For safe use follow the instructions given in the product data sheet. Based on our current knowledge, this product does not contain SVHC (substances of very high concern) as listed in Annex XIV of the REACH regulation or on the candidate list published by the European Chemicals Agency in concentrations above 0,1 % (w/w).

### LEGAL NOTE

The information, and, in particular, the recommendations relating to the application and end-use of Sika products, are given in good faith based on Sika's current knowledge and experience of the products when properly stored, handled and applied under normal conditions in accordance with Sikas recommendations. In practice, the differences in materials, substrates and actual site conditions are such that no warranty in respect of merchantability or of fitness for a particular purpose, nor any liability arising out of any legal relationship whatsoever, can be inferred either from this information, or from any written recommendations, or from any other advice offered. The user of the product must test the products suitability for the intended application and purpose. Sika reserves the right to change the properties of its products. The proprietary rights of third parties must be observed. All orders are accepted subject to our current terms of sale and delivery. Users must always refer to the most recent issue of the local Product Data Sheet for the product concerned, copies of which will be supplied on request.

#### Declaration of Performance

SikaSeal®-629 Fire Wrap

20971646

2020.06 , ver. 01

1545



**Sika Limited**

Watchmead  
Welwyn Garden City, Herts,  
AL7 1BQ  
UK  
<https://gbr.sika.com/>

**Sika Ireland Ltd**

Sika House, Ballymun  
Industrial Estate  
Dublin, D11 DA2V  
Ireland  
<https://irl.sika.com/>

**Declaration of Performance**

SikaSeal®-629 Fire Wrap  
20971646  
2020.06 , ver. 01  
1545

