

Sikacryl-625 Fire+

DECLARATION OF PERFORMANCE

No. 73598989

1	UNIQUE IDENTIFICATION CODE OF THE PRODUCT- TYPE:	73598989
2	INTENDED USE/S	EAD 350141-00-1106:2017 Fire Stopping and Sealing Product: • Linear Joint and Gap Seals
3	MANUFACTURER:	Sika Services AG Tüffenwies 16-22 8064 Zürich
4	AUTHORISED REPRESENTATIVE:	-
5	SYSTEM/S OF AVCP:	System 1
6b	EUROPEAN ASSESSMENT DOCUMENT:	EAD 350141-00-1106:2017
	European Technical Assessment:	ETA-21/1034 of 2021/11/24
	Technical Assessment Body:	ETA-Danmark A/S
	Notified body/ies:	2531

7 DECLARED PERFORMANCE/S

Essential Characteristics	Performance	AVCP	Harmonised Technical Specification
Reaction to fire	NPD	System 1	EAD 350141-00-1106:2017
Resistance to fire	Annex A	System 1	
Air permeability (material property)	NPD	System 1	
Water permeability (material property)	NPD	System 1	
Release of dangerous substances	NPD	System 1	
Mechanical resistance and stability	NPD	System 1	
Resistance to impact/movement	NPD	System 1	
Adhesion	NPD	System 1	
Airborne sound insulation - Sikacryl-625 Fire+ 1.0mm WFT on both sides of minimum 50mm thick stone wool mineral fibre board with density minimum 160kg/m3	Rw (C;Ctr) = 55 (-1;-1) dB	System 1	
Impact sound insulation	NPD	System 1	
Thermal properties	NPD		
Water vapour permeability	NPD		
Durability	Z ₂		


ANNEX A – RESISTANCE TO FIRE CLASSIFICATION – SIKACRYL-625 FIRE+

A.1 Rigid floor constructions with thickness of minimum 150 mm

A.1.1 Linear joint or gap seal, between floor slabs or between floor slab and wall with coating to the both faces of seal

Joint Seal: 60mm thick SikaSeal-626 Fire Board+ 60 2-S friction fitted at any position fully within the cavity* and sealed at the joint and along the top and bottom edges with FR Acrylic

Construction details:

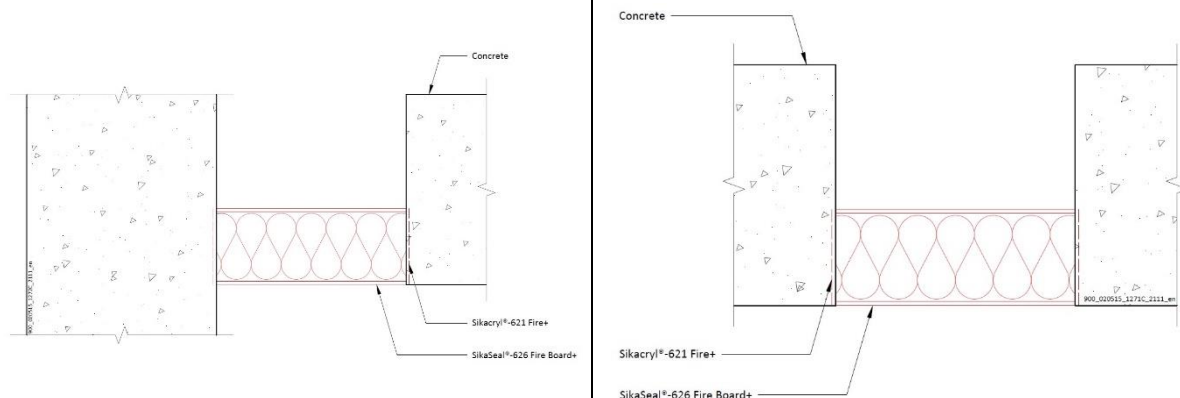

A.1.1.1

Substrate	Depth (mm)	Backing	Classification
masonry/ concrete	1 mm WFT min. Both sides	60 mm stone wool, mineral fibre batt	E 240 – H – X – F – W30-120 EI 120 – H – X – F – W30-120


Declaration of Performance

Sikacryl-625 Fire+
73598989
2021.12 , ver. 1
1549

Template for translation. Only for
internal use

A.1.2 Linear joint or gap seal, between floor slabs or between floor slab and wall with coating to the top face of seal only

Joint Seal: 100mm thick Stone wool, mineral fibre insulation friction fitted at least 50 mm above the soffit and coated on the top face with Sikacryl-625 Fire+

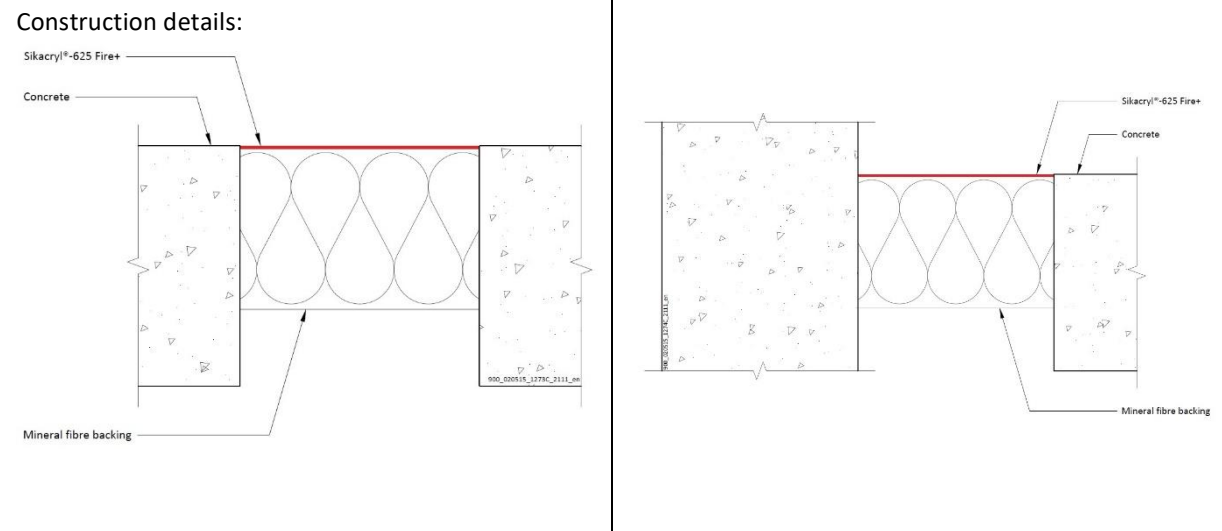



A.1.2.1

Substrate	Depth (mm)	Backing	Classification
masonry/ concrete	1 mm WFT min. top face	100 mm stone wool, mineral fibre min. 33 kg/m ³	E 240 – H – X – F – W120 EI 180 – H – X – F – W120

A.1.3 Linear joint or gap seal, between the head of walls (min. 150 mm thick) and the soffit of floor slabs or in walls (min. 150 mm thick) with coating to both faces

Joint Seal: 100mm thick Stone wool, mineral fibre insulation compression fitted to either face of the wall or at any position in between and coated on both faces with Sikacryl-625 Fire+

Construction details:

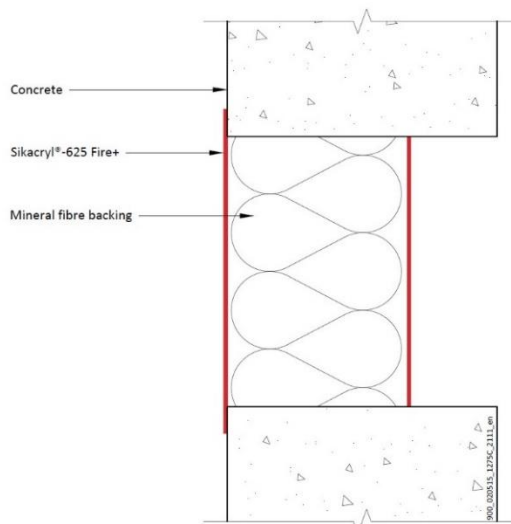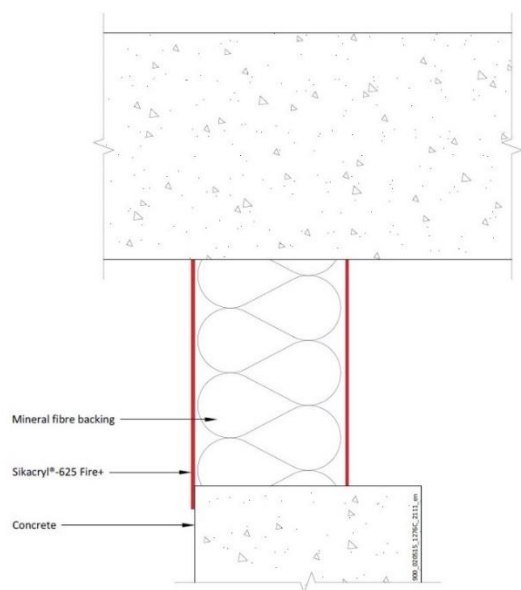

A.1.3.1

Substrate	Depth (mm)	Backing	Classification
masonry/ concrete	1.2 mm WFT min. both faces overlapped by 15 mm onto wall surface	100 mm stone wool, mineral fibre min. 35 kg/m ³ , compressed into gap by 40%	E 240 – T – X – F – W120 EI 180 – T – X – F – W120

Declaration of Performance

Sikacryl-625 Fire+
73598989
2021.12 , ver. 1
1549

Template for translation. Only for
internal use

8 APPROPRIATE TECHNICAL DOCUMENTATION AND/OR - SPECIFIC TECHNICAL DOCUMENTATION

The performance of the product identified above is in conformity with the set of declared performance/s. This declaration of performance is issued, in accordance with Regulation (EU) No 305/2011, under the sole responsibility of the manufacturer identified above.

Signed for and on behalf of the manufacturer by:


Name : Tomasz Gutowski
Function: Corporate Standardization
and Approvals
At Warsaw on 08 December 2021

Name : Maciej Michalewski
Function: Standardization and Approvals
At Warsaw on 08 December 2021



End of information as required by Regulation (EU) No 305/2011

FULL CE MARK

	
21	
Sika Services AG, Zurich, Switzerland	
73598989	
Resistance to fire – Annex A	
Airborne sound insulation - Sikacryl-625 Fire+ 1.0mm WFT on both sides of minimum 50mm thick stone wool mineral fibre board with density minimum 160kg/m ³ - Rw (C;Ctr) = 55 (-1;-1) dB	
Durability and serviceability Z ₂	

ANNEX A – RESISTANCE TO FIRE CLASSIFICATION – SIKACRYL-625 FIRE+

A.1 Rigid floor constructions with thickness of minimum 150 mm

A.1.1 Linear joint or gap seal, between floor slabs or between floor slab and wall with coating to the both faces of seal



Joint Seal: 60mm thick SikaSeal-626 Fire Board+ 60 2-S friction fitted at any position fully within the cavity* and sealed at the joint and along the top and bottom edges with FR Acrylic

Declaration of Performance

Sikacryl-625 Fire+
73598989
2021.12 , ver. 1
1549

Template for translation. Only for
internal use

Construction details:

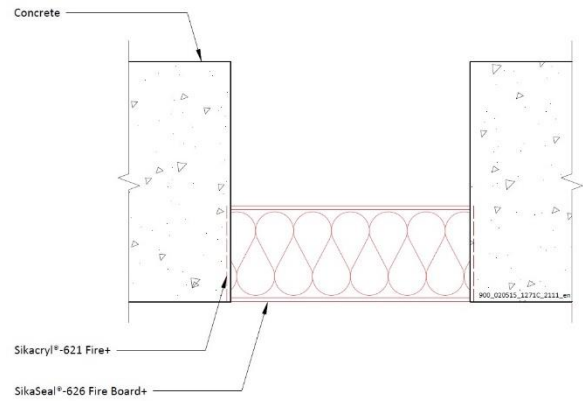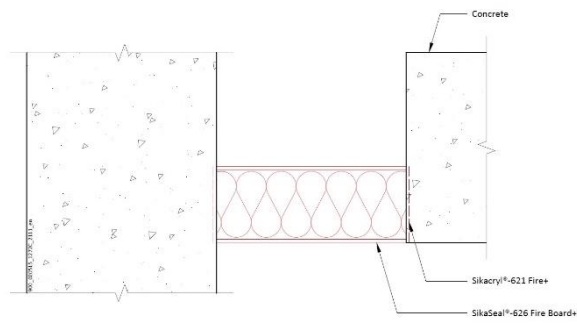

A.1.1.1

Substrate	Depth (mm)	Backing	Classification
masonry/ concrete	1 mm WFT min. Both sides	60 mm stone wool, mineral fibre batt	E 240 – H – X – F – W30-120 EI 120 – H – X – F – W30-120



Declaration of Performance
Sikacryl-625 Fire+
73598989
2021.12 , ver. 1
1549

Template for translation. Only for
internal use

A.1.2 Linear joint or gap seal, between floor slabs or between floor slab and wall with coating to the top face of seal only

Joint Seal: 100mm thick Stone wool, mineral fibre insulation friction fitted at least 50 mm above the soffit and coated on the top face with Sikacryl-625 Fire+

Construction details:

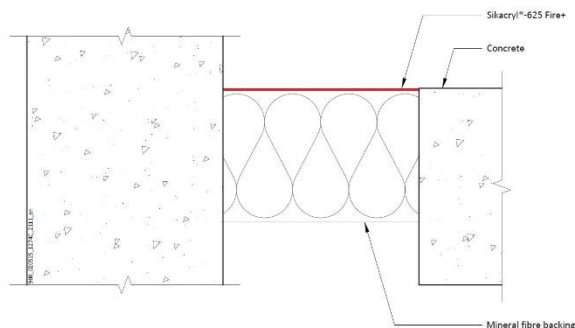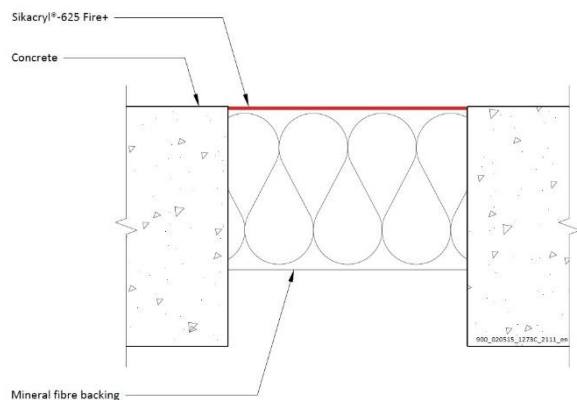

A.1.2.1

Substrate	Depth (mm)	Backing	Classification
masonry/ concrete	1 mm WFT min. top face	100 mm stone wool, mineral fibre min. 33 kg/m ³	E 240 – H – X – F – W120 EI 180 – H – X – F – W120

Declaration of Performance



Sikacryl-625 Fire+
73598989
2021.12 , ver. 1
1549

Template for translation. Only for
internal use

A.1.3 Linear joint or gap seal, between the head of walls (min. 150 mm thick) and the soffit of floor slabs or in walls (min. 150 mm thick) with coating to both faces

Joint Seal: 100mm thick Stone wool, mineral fibre insulation compression fitted to either face of the wall or at any position in between and coated on both faces with Sikacryl-625 Fire+

Construction details:

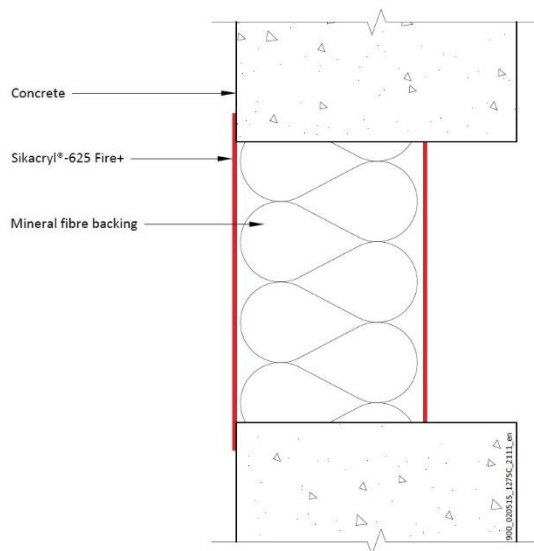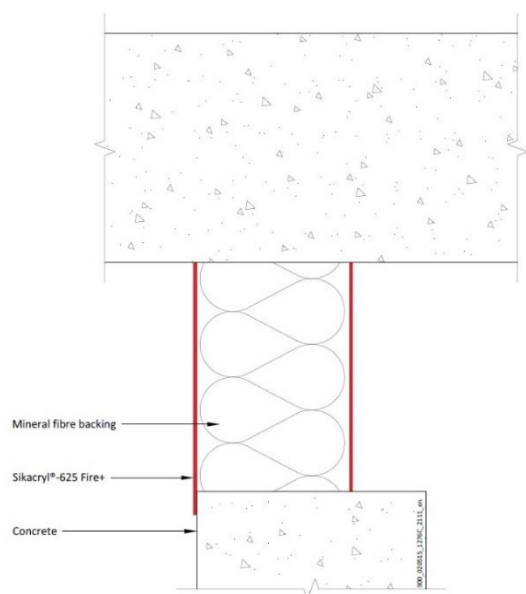

A.1.3.1

Substrate	Depth (mm)	Backing	Classification
masonry/ concrete	1.2 mm WFT min. both faces overlapped by 15 mm onto wall surface	100 mm stone wool, mineral fibre min. 35 kg/m ³ , compressed into gap by 40%	E 240 – T – X – F – W120 EI 180 – T – X – F – W120


EAD 350141-00-1106:2017
Notified Body 2531
Fire Stopping and Sealing Product: • Linear Joint and Gap Seals

<http://dop.sika.com>

Declaration of Performance
Sikacryl-625 Fire+
73598989
2021.12 , ver. 1
1549

Template for translation. Only for
internal use

CE mark to be placed on the label

 21	
Sika Services AG, Zurich, Switzerland	
73598989	
For details see accompanying documents	
EAD 350141-00-1106:2017	
Notified Body 2531	
Fire Stopping and Sealing Product: Linear Joint and Gap Seals	
http://dop.sika.com	

Declaration of Performance
Sikacryl-625 Fire+
73598989
2021.12 , ver. 1
1549

10/11

Template for translation. Only for
internal use

BUILDING TRUST



ECOLOGY, HEALTH AND SAFETY INFORMATION (REACH)

For information and advice on the safe handling, storage and disposal of chemical products, users shall refer to the most recent Safety Data Sheet (SDS) containing physical, ecological, toxicological and other safety related data.

LEGAL NOTE

The information, and, in particular, the recommendations relating to the application and end-use of Sika products, are given in good faith based on Sika's current knowledge and experience of the products when properly stored, handled and applied under normal conditions in accordance with Sikas recommendations. In practice, the differences in materials, substrates and actual site conditions are such that no warranty in respect of merchantability or of fitness for a particular purpose, nor any liability arising out of any legal relationship whatsoever, can be inferred either from this information, or from any written recommendations, or from any other advice offered. The user of the product must test the products suitability for the intended application and purpose. Sika reserves the right to change the properties of its products. The proprietary rights of third parties must be observed. All orders are accepted subject to our current terms of sale and delivery. Users must always refer to the most recent issue of the local Product Data Sheet for the product concerned, copies of which will be supplied on request.

Sika Services AG
Tüffenwies 16-22
8064 Zürich
Switzerland
www.sika.com

Declaration of Performance
Sikacryl-625 Fire+
73598989
2021.12 , ver. 1
1549

11/11

Template for translation. Only for
internal use

BUILDING TRUST

